

CORRIGENDUM -4 FOR NIT NO CMC/BR/24-25/FK/PR/KG/1231 for Survey, Design, Supply, Erection, Installation, Testing, Commissioning, Handing over of 03 Nos GIS Grid Substations along with associated Civil work and 08 Nos Cable In-feed/ Laying works on Turnkey Basis

CORRIGENDUM DATE: 30-01-2025

Sl. No.	Description	Status
1	GEOTECHNICAL SOIL INVESTIGATION OF NAWADA (Package -A Scheme no. 2).	ATTACHED
2	GEOTECHNICAL SOIL INVESTIGATION OF RAJOKARI (Package -A Scheme no. 3)	ATTACHED
3	Finishing schedule of tender's specification item No-1 is required modification as per following details	Refer Annexure-I

Annexure-I

<u>No</u>	<u>Location</u>	<u>Flooring</u>	<u>Wall Internal</u>	<u>Ceiling</u>	<u>Doors, Windows, Ventilators</u>
<u>1</u>	<u>Control room</u>	<u>Dust proof Epoxy Paint & False Flooring.as per specification clause No-6.5.2</u>	<u>Plastic emulsion Paint on smooth surface applied with putty</u>	<u>False Ceiling as per specification clause No-6.9(False ceiling)</u>	<u>Doors: 02 hours fire rated doors as per clause no. 6.10.b</u> <u>Windows & Ventilators: Aluminium Windows & Ventilators As per clause no. 6.10.c</u>

**NAME OF WORK: GEOTECHNICAL SOIL
INVESTIGATION OF NAWADA (RAJAPUR KHURD).**

GEOTECHNICAL REPORT

CLIENT: -



**BSES RAJDHANI POWER LIMITED
1ST FLOOR; C-BLOCK, BSES BHAWAN,
NEHRU PLACE DELHI, -110019.
TELEPHONE: 91-011 -39999444**

SOIL CONSULTANT:-



**M/S SWATI STRUCTURE SOLUTIONS PVT. LTD.
KH NO.7/9, GROUND FLOOR, NANGLOI,
JAT HARSUKH BLK, PREM NAGAR,
DELHI- 110041**



TABLE OF CONTENTS

Page No.

1.	Introduction	3
2.	Scope of Work	3
3.	Location of Bore Holes	3
4.	Field Investigation	4
5.	Ground Water Table	5
6.	Laboratory Tests	5
7.	Strength Characteristics of Soil	9
8.	Design Criteria	10
9.	Design Methodology	10
10.	Discussion on soil profile	12
11.	Chemical analysis	12
12.	Resistivity Test	13
13.	Bearing capacity	13
14.	Recommendations	14
15.	Closure	14
16.	Soil Profile	15
17.	Grain Size Analysis	19
18.	Results of Direct Shear Test	23
19.	Subsoil Profile (Fig. A)	25
20.	Site Photo	26
21.	List of Reference IS Codes	28



ABBREVIATION

BH	Borehole
ERT	Earth resistivity testing
IS	Indian standard
N Values	No of blows/30cm from standard penetration test
γ_d	Dry Density of Soil
N_m	Uncorrected SPT blow count
Q_{ab}	Allowable Net Bearing capacity
C	Cohesion in N/mm^2
B	Width of footing in m
D	Depth of Foundation in m
G	Specific Gravity
e	Void ratio
d_q, d_r, d_c	Depth factors
S_q, S_c, S_γ	Shape factors
I_q, I_r, I_c	Inclination factors
$N'_c, N'_q, N'_r,$	Bearing capacity factor
q	Total surcharge at the base level of foundation
W'	Water table correction factor
Φ	Angle of shearing resistance of soil
N_R	Recorded standard penetration value
N_C	Corrected standard penetration value
k	Modulus of sub-grade reaction
EGL	Existing Ground Level
Q_u	Ultimate bearing capacity
q_s	Safe Bearing Capacity



1.0 INTRODUCTION

The work of geotechnical investigation for Nawada, (Rajapur Khurd). has been assigned to M/S Swati Structure Solutions Pvt. Ltd., having its address at KH No.7/9, Ground floor, Nangloi, Jat Harsukh BLK, Prem nagar, Delhi- 110041 by the BSES Rajdhani Power Limited with its address at 1st Floor; C-Block, BSES Bhawan, Nehru Place Delhi, - 110019. The report presents the details of field investigation carried out in the month of January 2025 and the results are obtained from various fields and laboratory tests based on computation. Foundation analysis has been done and recommendation has been made as regards to suitable type of foundations to be provided for the proposed structure.

2.0 SCOPE OF WORK

- a) Mobilization and demobilization of all relevant men and machinery including all T&P required for carrying out soil investigation work as per direction of Engineer-in-charge.
- b) Drilling 4 Nos. Bore holes up to the depth of 15 or refusal whichever is earlier below the ground surface by shell and auger method.
- c) Conducting Standard Penetration Test at 1.50m regular interval as per Indian Standard Specification.
- d) Collection of disturbed and undisturbed soil samples from the bore holes at regular interval of 3.0m or change of strata.
- e) Carrying out lab test to find physical properties of sub soil strata.
- f) Recording of water table level in the bore hole after completion of bore hole.
- g) Preparation and submission of report incorporating all the data obtained from the field and laboratory tests.
- h) Evaluation of SBC based on shear & settlement Criteria.
- i) The field testing for bore holes has been done on 18/01/2025 to 22/01/2025

3.0 LOCATION OF BORE HOLES

Four nos. of bore holes are drilled at the proposed site. All the test locations are given by the client.



4.0 FIELD INVESTIGATION

4.1 Grain size distribution of soil at various depths has been carried out and grain size distribution curve is drawn. The soil type and shear parameters as obtained in the various bore-hole are given in the table below:

Bore Hole (BH) No.	Subsoil Layers	Soil Type	Shear Parameters	
			Cohesion c in Kg/cm ²	Action of friction (in Degree)
BH-1	Layer-1 (0.0m to 15m)	Silty Sand	0.016	25 ⁰
BH-2	Layer-1 (0.0m to 1.7m)	Filled up soil	-	-
	Layer-2 (1.7 to 15.0m)	Silty Sand	0.016	25 ⁰
BH-3	Layer-1 (0.0m to 1.3m)	Filled up soil	-	-
	Layer-2 (1.3 to 15.0m)	Silty Sand	0.016	25 ⁰
BH-4	Layer-1 (0.0m to 1.2m)	Filled up soil	-	-
	Layer-2 (1.2 to 15.0m)	Silty Sand	0.016	25 ⁰

4.2 Subsurface Exploration

Subsurface Exploration was carried out in 4 no. of bore hole at site using rotary drilling. The depth of bore- hole was taken from the existing ground surface.

4.3 Boring

The bore holes of 150 mm dia. were drilled by using rotary drilling method to collect soil sample up to the specified depth.

4.5 Standard Penetration Test (SPT)

Standard penetration tests as per IS: 2131-1981 was conducted at the bore hole, each at 1.5m interval or change of strata. The tests were performed by using a standard split spoon sampler attached to 'A' rod placed at the test level in the bore hole. The sampler was driven to a depth of 45cm by means of a standard hammer weighing 63.5 Kg. falling freely through a vertical height of 75 cm. Blows required for each 15 cm penetration (Total penetration 45cm) were recorded and the number of blows for last 30cm penetration of the sampler was taken as N values. Blows for first 15 cm penetration of the sampler in each test, were discarded owing to the possible disturbance of the strata during auguring



operations. The observed and the corrected N SPT values (IS: 2131-1981) are given with graphical representation on and soil profile.

5.0 GROUND WATER TABLE

Water table was encountered in the bore hole at the depth of 11.25m to 13m as given in bore log data.

6.0 LABORATORY TESTS

A visual and discrete examination of all the soil samples collected was carried out for deciding the number and type of tests as well as the number of samples to be tested from each bore hole. Based on the strata met at site the following tests were conducted on samples to classify them and to evaluate their index and Engineering properties

- a) Grain size distribution
- b) Bulk density and Moisture content
- c) Direct Shear Test
- d) Triaxial Tests
- e) Liquid limits and plastic limits
- f) Specific Gravity
- g) Chemical analysis of soil and water for chloride and sulphate content.
- h) Electrical resistivity test.

a) Grain Size Distribution

Grain size distribution of the soil is determined by sieving the soil sample in a set of IS sieves: 4.75mm, 2.36mm, 0.825mm, 0.6mm, 0.425mm, 0.30mm, 0.150mm, 0.075mm size. Grain Size Analysis curve has been plotted and attached in the appendices of this report for the soil samples collected from various depths of bore-holes.

b) Bulk Density And Natural Moisture Content

Undisturbed samples were collected from the boreholes in thin wall steel sample tubes by taking the dimensions and weight of these sample tubes, the bulk density of the soil is determined. Moisture content of the soil has been calculated by Oven Drying Method.



c) Direct Shear Test

A direct shear test is a laboratory or field test used by geotechnical engineers to measure the shear strength properties of soil or rock material, or of discontinuities in soil or rock masses. The test is performed on specimens from undisturbed soil sample. A specimen is placed in a shear box which has two stacked rings to hold the sample; the contact between the two rings is at approximately the mid-height of the sample. A confining stress is applied vertically to the specimen, and the upper ring is pulled laterally until the sample fails, or through a specified strain. The load applied and the strain induced is recorded at frequent intervals to determine a stress-strain curve for each confining stress. Several specimens are tested at varying confining stresses to determine the shear strength parameters, the soil cohesion (c) and the angle of internal friction (commonly friction angle) (ϕ). The results of the tests on each specimen are plotted on a graph with the peak (or residual) stress on the x-axis and the confining stress on the y-axis. The y-intercept of the curve which fits the test results is the cohesion, and the slope of the line or curve is the friction angle.

d) Triaxial Test

In this test undisturbed soil specimen is subjected to 3 compressive stresses at right angle to one another, horizontally confining constantly and the vertical stress is gradually increased until each specimen fails to evaluate cohesion and angle of shearing resistance. Triaxial shear tests have been performed by subjecting the cohesive-soil samples to major principal stresses in increase steps. The test specimen is allowed to consolidate under a number of successive increments of vertical pressure, each pressure increment being maintained constant until the deformation ceases, generally in 24 hours. The successive pressure employed are 0.10, 0.20, 0.40, 0.60, 0.80, 1.0, 1.5, 2.0, 2.5, 3.0, 3.5, 4.0 and 5.0 kg/cm². Thus, these stress increments are progressively carried-out until the failure of the specimen. The dial gauge readings for measuring the deformation are taken after the application of the pressure increment at the following total elapsed time of 0.25, 1.0, 4.0, 9.0, 16.0, 25.0, 36.0, 49.0, 64.0, 81 and 100 minutes until the consolidation is completed.



e) Atterberg Limits

Atterberg Limits in the form of liquid limit, plastic limit and shrinkage limit are determined for the soil to establish its consistency. In the case of cohesion less soil, plastic limit is first determined and if it cannot be determined the soil sample is reported to be non-plastic.

f) Specific Gravity

Specific Gravity of the soil has been determined by Specific Gravity Bottle.

g) Chemical analysis of soil and water for chloride and sulphate content.

- i. Heat the clean evaporating dish to 180°C for 1 hour. Cool in the desiccator, weigh and store in the desiccator until ready for use.
- ii. Filter a portion of the sample through any of the filters mentioned in 4.1, Select volume of the sample which has residue between 25 and 250 mg. preferably between 100 to 200 mg. This volume may be estimated from values of specific conductance. To obtain a measurable residue. Successive aliquots of filtered sample may be added to the sample dish,
- iii. Pipette this volume to a weighed evaporating dish placed on a-steam-bath. Evaporation may also be performed in a drying oven. The temperature shall be lowered to approximately 98°C to prevent boiling and splattering of the sample. After complete evaporation of water from the residue. Transfer the dish to an oven at 103-105°C or 179-181°C and dry to constant mass, that is, till the difference in the successive weighings is less than 0-5 mg. Drying for a long duration (usually 1 to 2 hours) is done to eliminate necessity of checking for constant mass. The time for drying to constant mass with a given type of sample when a number of samples of nearly same type are to be analysed has to be determined by trial.
- iv. Weigh the dish as soon as it has cooled avoiding residue to stay for long time as some residues are hygroscopic and may absorb water from desiccant that is not absolutely dry.



h) Electrical resistivity test

The purpose of electrical resistivity survey is to determine the subsurface resistivity distribution by making measurements on the ground surface. From these measurements the true resistivity of the subsurface can be estimated against corrosion. The ground resistivity is related to various geological parameters, such as, the mineral and fluid Content, porosity and degree of water saturation in rock. Electrical resistivity surveys have been used for many decades in hydrogeological, mining and geotechnical investigations. More recently, it has been used for environmental surveys. It has the following other purposes:

- a) To rapidly explore the subsurface conditions in order to locate ground water, thickness of overburden, depth to different rock types and stratigraphic features.
- b) To delineate weak formations, faults and dykes, if any, and to identify location of steeply dipping contacts between different rock types and earth material.
- c) To delineate zones of seepage and identify its source around various structures of river valley projects.
- d) Assessment of groundwater potential, quality and determination of aquifer characteristics.
- e) To correlate data from resistivity survey with those obtained from borehole and trial pit logs.

For earthing of electrical conductors.

Range of Soil Resistivity (ohm-metres)	(Class of Soil)
Less than 25	Severely corrosive
25-50	Moderately corrosive
50-100	Mildly corrosive
Above 100	Very mildly corrosive



7.0 STRENGTH CHARACTERISTICS OF SOIL

The strength of a material is defined as the greatest stress it can sustain. If the stress exceeds strength, failure occurs. Strength analysis can be performed for tensile, compressive and shear stresses. Since soil mass has very little or negligible tensile strength, hence tensile strength analysis is rarely performed. Normally the geometry of most geotechnical problems is such that the soil mass is in compression, but do not fail in compression. Although the introduction of large compressive stresses may result in soil failure, the soil is actually failing in shear, not in compression. Therefore, nearly all geotechnical strength analysis is performed for shear stresses. The shear strength of a soil in any direction is the maximum shear stress that can be applied to the soil in that direction. It can also be defined as the resistance to deformation by continuous shear displacement of soil particles.

The shear strength of soil is basically made up of the following components:

(i) Frictional component:

It is mainly due to interlocking of soil particles and the friction between them.

(ii) Cohesion component:

It is due to mutual attraction that exists between the fine particles of some soils. The shear strength of cohesive soil results both from friction as well as cohesion whereas for cohesion-less soil it results from friction alone.

The shear strength equation was first proposed by French engineer Coulomb. He expressed the shear strength's' as a linear function of total normal stress ' σ ' on the potential surface of sliding

$$s = c + \sigma \tan (\phi)$$

Where s = shear strength

To assess the strength characteristics of soil at the proposed site 4 nos. of bore hole were drilled up to the depth mentioned in the bore log data. This Bore hole was advanced by Shell and Auger method up to the depth specified below the ground surface. While advancing the bore holes SPT tests were conducted at regular intervals of 1.5m depth and representative samples were collected and analyzed for soil classification. Water table was encountered in the bore hole at the depth of 11.25m to 13m as given in bore log data. The SPT values obtained have been corrected for overburden pressure. These corrected values have been plotted against depth and are shown in the respective bore log. It has been seen from the plots that the SPT values varying from 12 to 40 has been achieved for various bore holes and at various depth as shown in bore log plot between SPT value and depth. Direct Shear Tests were conducted on undisturbed soil samples collected at regular intervals of 1.5m for evaluating the shear parameters. The results are shown in the bore log.

8.0 DESIGN CRITERIA

Any foundation (shallow footing) is to be safe against possible failure against

- a) Excessive shear Failure (the bearing pressure should be within the permissible limits)
- b) Excessive settlement

The settlement depends not only on the type of soil below the foundation but also on the type of foundation, material used for construction and functionality of the structure.

9.0 DESIGN METHODOLOGY FOR SOIL

9.1 Isolated foundation

Since the structure to be constructed on this site is G+1 framed structure Isolated foundation has been analyzed, at a depth of 2.5m below EGL as required by the client on limited soil sample. An allowable settlement of 50mm settlement for isolated footing has been considered as per IS: 1904 – 1986. The evaluation of SBC of foundation has been done using following two criteria

Shear Failure Criteria

The safe bearing pressure from interpolation of General & Local Shear failure criteria can be obtained, using the Equation given below

$$Q_{ab} = 0.67C N_c S_c d_c i_c + q (N_q - 1) s_q d_q i_q + 0.5 B \gamma N_r S_r d_r i_r W' \gamma$$

Where

C = cohesion in KN/m²

B = Width of the footing in m

d_q, d_y, d_c = Depth factors

S_q, S_y, S_c = Shape factors

I_q, I_y, I_c = Inclination factors

N'_q, N'_y, N'_c = Bearing capacity factor

q = Total surcharge at the base level of foundation

W' = Water table correction factor (Considered for flooding and heavy rain)

γ = Bulk unit wt. of foundation soil, in KN/m³

a) Settlements:

- i) Soil profile is given for each bore hole. The Soil profile which is likely to cause greater settlements is to be considered for calculations.
- ii) The imposed load at the foundation level is likely to compress the soil up to the depth of approximately equal to 1.5B below the foundations.
- iii) The settlements can be calculated using IS-8009 part-I & II.



SAMPLE CALCULATION FOR ISOLATED FOUNDATION 2.5M DEPTH FOR SHEAR CRITERIA

SAFE BEARING CAPACITY		
Symbol	Description	Value
C	Cohesion	1.6 KN/m²
ϕ	Angle of shearing resistance of soil in degrees	25
ϕ_m	Angle of shearing resistance of soil in degrees [$\tan^{-1}(0.67(\tan \phi))$]	17.35
G	Specific Gravity	2.65
γ_d	Dry Density of Soil	15.10
e	Void ratio [$(G\gamma_w/\gamma_d)-1$]	0.75
Interpolation of Bearing Capacity Factor		
N' _c	Bearing Capacity Factor (Local Shear)	12.79
N' _q	Bearing Capacity Factor (Local Shear)	5.10
N' _r	Bearing Capacity Factor (Local Shear)	3.94
	Shape of Base	Square
S _c	Shape Factor (Square)	1.30
S _q	Shape Factor (Square)	1.20
S _r	Shape Factor (Square)	0.80
D	Depth of Foundation	2.5
B	Width of Foundation	2
N ϕ	$\tan^2 (\pi/4 + \phi/2)$	0.028
d _c	Depth Factors ($1 + 0.2 Dt/B\sqrt{N\phi}$)	1.04
i _c	Inclination Factors	1
i _q	Inclination Factors	1
i _r	Inclination Factors	1
γ	Density at Foundation Level	17.40 KN/m ³
q	Total surcharge at the base level of foundation ($\gamma \times D$)	43.50 KN/m ³
d _q = d _r	Depth Factors (1 for $\phi < 10^\circ$)	-
d _q = d _r	Depth Factors ($1+0.1 Dt/B\sqrt{N\phi}$ for $\phi < 10^\circ$)	1.021
R _{w1}	Reduction Factor	1
Q _u	Ultimat bearing capacity of Foundation	$Q_u = 0.5 C N_c S_c d_c i_c + q (N_q-1) s_q d_q i_q + 0.5 B \gamma N_r S_r d_r i_r R_{w1}$
Q_u	Ultimat bearing capacity of Foundation	288 KN/m²
FS	Factor of Safety	2.5
q_s	Q_u/FS	115 KN/m²
	Allowable Bearing Capacity of Foundation	11.51 t/m²



SAMPLE CALCULATION FOR ISOLATED FOUNDATION 2.5M DEPTH FOR SETTLEMENTS CRITERIA

SETTLEMENT CONSIDERATION AS PER IS: 8009 Part I (Fig. 9) (AT THE DEPTH OF 2.5M FROM E.G.L.)		
N _R	N Value Recorded at a depth of 2.5m	12.0
N _C	N Value Corrected at a depth of 2.5m	12.0
B	Width of Footing	2.0 m
	Permissible Settlement As Per IS: 8009 Part I(Fig. 9)	50 mm
	Settlement by applying 1kg/sqcm pressure as per IS:8009-I - 1976	25.0 mm
	Corrected settlement by applying W' (RW) for 1 kg/cm ²	25.0 mm
	Pressure allowed for 50mm settlement (50/corr. Settlement)	2.000
	Bearing Capacity of Foundation	20.00 t/m²
	Allowable Bearing Capacity of Foundation	20.00 t/m²

10.0 DISCUSSION ON SOIL PROFILE

Results of field and laboratory tests indicate that the soil strata in all bore holes filled up soil up to a maximum depth of 1.7m. Below 1.7m soil strata is Silty Sand up to the depth of exploration (15m). Bore log data of various bore holes are shown in Fig. A.

11.0 CHEMICAL ANALYSIS OF SOIL AND WATER (BIS CODE IS: 456-2000)

S. No	Test Parameters	Test Method	Requirements As per IS:10500-2012	Results
			Acceptable Limit	
1.	Colour, Hazen units	IS:3025 (Part-4)1983	5.0 Max	2.46
2.	Odour	IS:3025 (Part-5)1983	Agreeable	Agreeable
3.	pH value	IS:3025 (Part-11)1983	6.5 to 8.5	8.2
4.	Taste	IS:3025 (Part-7&8)1984	Agreeable	Agreeable
5.	Turbidity, NTU	IS:3025 (Part-10)1984	1.0 Max	0.68
6.	Total Dissolved solids, mg/l	IS:3025 (Part-16)1984	500 Max	492.3
7.	Fluoride, (as F) mg/l	IS:3025 (Part-10)1984	1.0 Max	BDL
8.	Sulphate, (as SO ₄) mg/l	IS:3025 (Part-24)1986	200.0 Max	145.6
9.	Iron, (as Fe). mg/l	IS:3025 (Part-53) 2003	0.30 Max	BDL
10.	Chloride (as Cl) mg/l	IS:3025 (Part-32)1988	250 Max	159.2
11.	Total Hardness ca (as CaCO ₃), mg/l	IS:3025 (Part-40)1991	200 Max	126.5
12.	Total Alkalinity, mg/l	IS:3025 (Part-23)1986	200 Max	159.2



12.0 RESULTS OF ELECTRICAL RESISTIVITY TEST (IS CODE: 3043 – 1987)

EARTH RESISTIVITY TEST								
PROJECT:-		GEOTECHNICAL SOIL INVESTIGATION OF NAWADA (RAJAPUR KHURD)						
LOCATION:-		NEW DELHI						
DATE OF TESTING:-		22.01.2025						
RESULTS								
LOCATION 1								
DIRECTION	NORTH (1)		SOUTH (2)		EAST (3)		WEST (4)	
PROBE DISTANCE "S" (M)	MEGGER READING "R" (Ω)	RESISTIVITY (Ω -M) $\rho = 2 \times 3.14 \times S \times R$	MEGGER READING "R" (Ω)	RESISTIVITY (Ω -M) $\rho = 2 \times 3.14 \times S \times R$	MEGGER READING "R" (Ω)	RESISTIVITY (Ω -M) $\rho = 2 \times 3.14 \times S \times R$	MEGGER READING "R" (Ω)	RESISTIVITY (Ω -M) $\rho = 2 \times 3.14 \times S \times R$
0.5	1.72	5.40	1.68	5.28	1.92	6.03	1.96	6.15
1	1.52	9.55	1.62	10.17	1.84	11.56	1.86	11.68
2	1.68	21.10	1.72	21.60	1.92	24.12	1.76	22.11
3	1.72	32.40	1.68	31.65	1.76	33.16	1.88	35.42
LOCATION 1								
DIRECTION		AVERAGE RESISTIVITY (Ω -M)						
NORTH (1)		17.11						
SOUTH (2)		17.18						
EAST (3)		18.71						
WEST (4)		18.84						

13.0 BEARING CAPACITY

13.1 FROM SHEAR CRITERIA

ISOLATED FOUNDATION

Depth of Foundation (m)	Founding Level of Foundation (m)	Size of footing (m)	Net Allowable Bearing Capacity (T/Sq.M)
2.5	Isolated	2.0X2.0	11.51
		2.5X2.5	12.02



13.2 FROM SETTLEMENT CRITERIA

ISOLATED/RAFT FOUNDATION

Depth of Foundation (m)	Founding Level of Foundation (m)	Size of footing (m)	Net Allowable Bearing Capacity (T/Sq.M)
2.5	Isolated	2.0X2.0	20.0
		2.5X2.5	19.23

14.0 RECOMMENDATIONS

ISOLATED FOUNDATION

Depth of Foundation (m)	Founding Level of Foundation (m)	Size of footing (m)	Net Allowable Bearing Capacity (T/Sq.M)
2.5	Isolated	2.0X2.0	11.51
		2.5X2.5	12.02

NOTE:-

1. If any loose pockets are observed during excavation for foundation, the same shall be filled with PCC 1:5:10. Foundation can subsequently be placed over this prepared surface.
2. If the profile of soil at any location differs from what is shown, the same shall be brought in notice of soil consultant before laying any foundation.

15.0 CLOSURE

We appreciate the opportunity to perform this investigation for you and have pleasure in submitting this report. Please contact us when we can be of further service to you.

For Swati Structure Solutions Pvt. Ltd



Er. Shubham Ojha


**SWATI STRUCTURE SOLUTIONS PVT.
LTD.**

S.P.T. PLOT
Observed —▲—
Corrected —×—

PROJECT: GEOTECHNICAL SOIL INVESTIGATION OF NAWADA (RAJAPUR KHURD).


SHEET NO 15

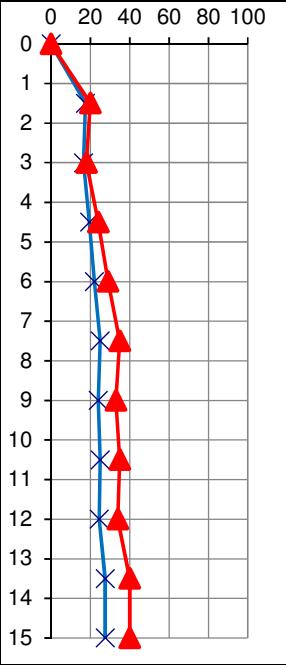

N Values	N Values Corrected	DEPTH (m)	Type of Sample	Soil Classification
		0.50	DS-1	RCC
20	18	1.95	SPT-1	Silty Sand
		2.80	UDS-1	
18	17	3.45	SPT-2	
24	20	4.95	SPT-3	
		5.80	UDS-2	
29	22	6.45	SPT-4	
35	25	7.95	SPT-5	
		8.80	UDS-3	
33	24	9.45	SPT-6	
35	25	10.95	SPT-7	
		11.80	UDS-4	
34	25	12.45	SPT-8	
40	28	13.95	SPT-9	
40	28	15.45	SPT-10	




BOREHOLE NO				TERMINAL DEPTH (m)				Water Table					
BH 1				15.0 meter				11.25 meter					
GRAIN SIZE ANALYSIS				LIQUID LIMIT	PLASTIC LIMIT	DRY DENSITY	BULK DENSITY	MOIST. CONT.	SHEAR PARAMETER			Sp. Gr.	
GRAVEL %	SAND %	SILT %	CLAY %	%	%	gm/cc	gm/cc	%	TEST TYPE	C Kg/cm ²	f deg.		
	2.4	78.8	15.3	3.5	19	NP							
							1.51	1.74	15	UU	0.016	25	2.65
	1.8	81.4	13.0	3.8	22	NP							
	4.0	83.4	10.0	2.6	21	NP							
							1.48	1.75	18	UU	0.016	25	2.65
	7.8	79.9	7.8	4.5	22	NP							
	1.4	80.4	14.9	3.3	19	NP							
							1.47	1.75	19	UU	0.016	25	2.66
	8.2	83.4	6.7	1.8	23	NP							
	2.5	89.3	6.0	2.2	23	NP							
							1.46	1.77	22	UU	0.016	25	2.66
	3.1	85.6	8.4	2.8	22	NP							
	2.6	81.9	13.1	2.4	24	NP							
	2.4	83.1	12.2	2.3	23	NP							

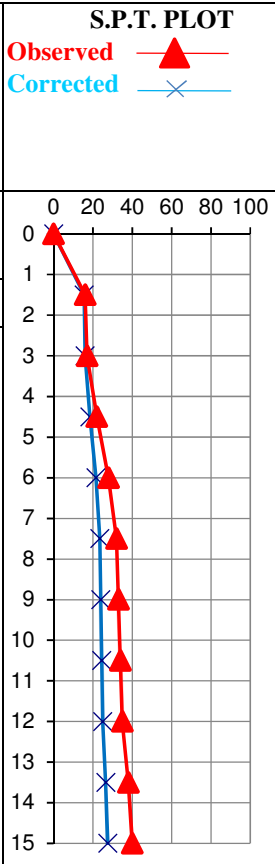SWATI STRUCTURE SOLUTIONS PVT. LTD.					S.P.T. PLOT		PROJECT: GEOTECHNICAL SOIL INVESTIGATION OF NAWADA (RAJAPUR KHURD).										SHEET NO 16				
					Observed Corrected		BOREHOLE NO					TERMINAL DEPTH (m)					Water Table				
							BH 2					15.0 meter					13.00 meter				
N Values		N Values Corrected		DEPTH (m)	Type of Sample	Soil Classification	GRAIN SIZE ANALYSIS				LIQUID LIMIT	PLASTIC LIMIT	DRY DENSITY	BULK DENSITY	MOIST. CONT.	SHEAR PARAMETER			Sp. Gr.		
							GRAVEL	SAND	SILT	CLAY						TEST TYPE	C	f			
							%	%	%	%	%	%	gm/cc	gm/cc	%		Kg/cm ²	deg.			
				0.50	DS-1	Filled Up Soil															
16	16			1.95	SPT-1	Silty Sand	6.8	80.0	10.3	2.9	20	NP									
				2.80	UDS-1								1.50	1.74	16	UU	0.016	25	2.65		
17	16			3.45	SPT-2		4.1	76.8	12.2	6.9	21	NP									
22	19			4.95	SPT-3		0.0	81.2	12.0	6.8	22	NP									
				5.80	UDS-2								1.44	1.74	21	UU	0.016	25	2.65		
28	22			6.45	SPT-4		1.4	77.9	12.3	8.4	22	NP									
32	24			7.95	SPT-5		2.2	78.1	12.7	7.0	20	NP									
				8.80	UDS-3								1.46	1.75	20	UU	0.016	25	2.65		
33	24			9.45	SPT-6		3.0	79.3	11.1	6.6	21	NP									
34	25			10.95	SPT-7		3.9	81.3	9.4	5.4	22	NP									
				11.80	UDS-4							1.46	1.77	21	UU	0.016	25	2.67			
35	25			12.45	SPT-8	4.6	67.7	16.7	11.0	23	NP										
38	27			13.95	SPT-9	5.6	77.6	10.3	6.4	22	NP										
40	28			15.45	SPT-10	5.8	76.9	10.7	6.6	21	NP										




SWATI STRUCTURE SOLUTIONS PVT. LTD.					S.P.T. PLOT Observed  Corrected 		PROJECT: GEOTECHNICAL SOIL INVESTIGATION OF NAWADA (RAJAPUR KHURD).								SHEET NO 17					
					BOREHOLE NO		TERMINAL DEPTH (m)				Water Table									
					BH 3		15.0 meter				13.00 meter									
N Values		N Values Corrected		DEPTH (m)	Type of Sample	Soil Classification	GRAIN SIZE ANALYSIS				LIQUID LIMIT	PLASTIC LIMIT	DRY DENSITY	BULK DENSITY	MOIST. CONT.	SHEAR PARAMETER			Sp. Gr.	
							GRAVEL	SAND	SILT	CLAY					TEST TYPE	C	f			
							%	%	%	%	%	gm/cc	gm/cc	%		Kg/cm ²	deg.			
				0.50	DS-1	Filled Up Soil														
14	14			1.95	SPT-1	Silty Sand	2.2	80.0	14.4	3.3	18	NP								
				2.80	UDS-1								1.50	1.74	16	UU	0.016	25	2.65	
16	16			3.45	SPT-2			1.6	82.9	12.0	3.4	21	NP							
17	16			4.95	SPT-3			3.4	85.7	8.6	2.3	22	NP							
				5.80	UDS-2								1.47	1.75	19	UU	0.016	25	2.66	
21	18			6.45	SPT-4			7.2	81.5	7.2	4.2	21	NP							
18	17			7.95	SPT-5			1.2	82.9	13.0	2.9	21	NP							
				8.80	UDS-3								1.45	1.75	21	UU	0.016	25	2.65	
20	18			9.45	SPT-6			7.8	84.1	6.4	1.7	22	NP							
23	19			10.95	SPT-7			2.2	90.4	5.3	2.0	24	NP							
				11.80	UDS-4							1.45	1.76	21	UU	0.016	25	2.66		
35	25			12.45	SPT-8		2.8	87.1	7.5	2.6	21	NP								
34	25			13.95	SPT-9		2.6	81.9	13.1	2.4	22	NP								
42	29			15.45	SPT-10		2.3	83.9	11.7	2.2	24	NP								

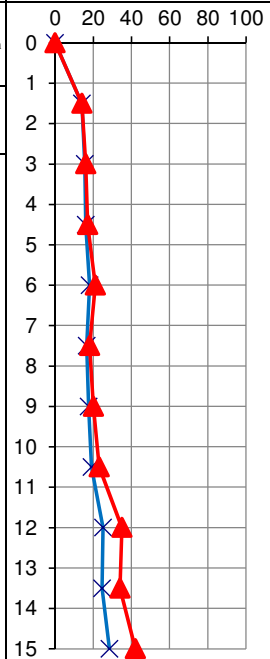

SWATI STRUCTURE SOLUTIONS PVT. LTD.					S.P.T. PLOT		PROJECT: GEOTECHNICAL SOIL INVESTIGATION OF NAWADA (RAJAPUR KHURD).										SHEET NO 18							
					Observed —▲— Corrected —×—		BOREHOLE NO				TERMINAL DEPTH (m)				Water Table									
							BH 4				15.0 meter				13.00 meter									
N Values	N Values Corrected	DEPTH (m)	Type of Sample	Soil Classification	0	20	40	60	80	100	GRAIN SIZE ANALYSIS				LIQUID LIMIT	PLASTIC LIMIT	DRY DENSITY	BULK DENSITY	MOIST. CONT.	SHEAR PARAMETER			Sp. Gr.	
											GRAVEL	SAND	SILT	CLAY						TEST TYPE	C	f		
											%	%	%	%	%	gm/cc	gm/cc	%		Kg/cm ²	deg.			
		0.50	DS-1	Filled Up Soil	0																			
12	12	1.95	SPT-1	Silty Sand	1						7.7	77.2	11.7	3.3	20	NP				UU	0.016	25	2.65	
		2.80	UDS-1			2											1.50	1.74	16					
12	12	3.45	SPT-2			3						4.3	75.9	12.7	7.2	22	NP							
16	16	4.95	SPT-3			4						0.0	82.9	11.0	6.2	22	NP							
		5.80	UDS-2			5											1.50	1.75	17	UU	0.016	25	2.65	
22	19	6.45	SPT-4			6						1.4	78.2	12.1	8.3	21	NP							
31	23	7.95	SPT-5			7						2.2	78.7	12.3	6.8	20	NP							
		8.80	UDS-3			8											1.46	1.75	20	UU	0.016	25	2.65	
26	21	9.45	SPT-6			9						2.6	82.1	9.6	5.8	22	NP							
35	25	10.95	SPT-7			10						3.4	83.5	8.3	4.8	22	NP							
		11.80	UDS-4		11											1.45	1.75	21	UU	0.016	25	2.66		
30	23	12.45	SPT-8		12						4.0	72.0	14.4	9.6	21	NP								
33	24	13.95	SPT-9		13						5.0	80.0	9.3	5.7	22	NP								
35	25	15.45	SPT-10		14						6.6	73.9	12.0	7.5	24	NP								

GRAIN SIZE ANALYSIS


BORE HOLE NO. BH - 1

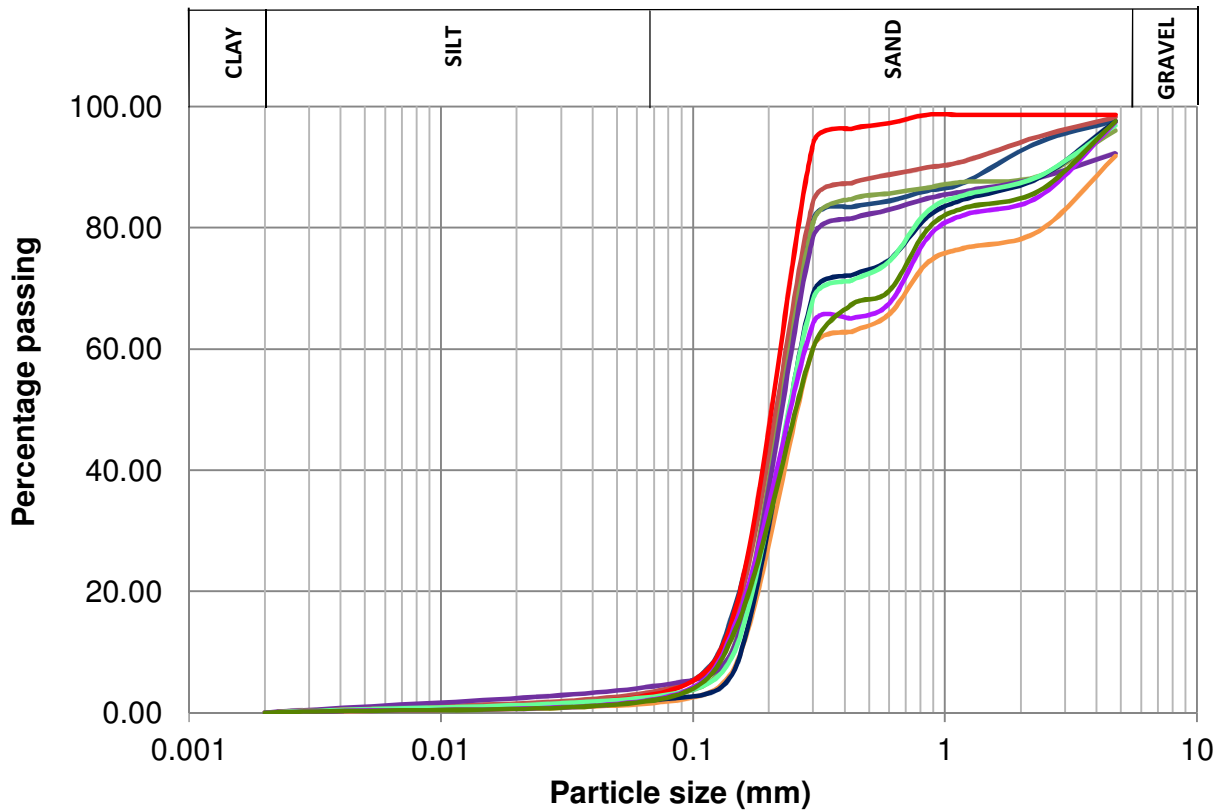

Symbol	Description	Depth (m)	Gravel (%)	Sand (%)	Silt (%)	Clay (%)
—	Silty Sand	1.50	2.4	78.8	15.3	3.5
—	Silty Sand	3.00	1.8	81.4	13.0	3.8
—	Silty Sand	4.50	4.0	83.4	10.0	2.6
—	Silty Sand	6.00	7.8	79.9	7.8	4.5
—	Silty Sand	7.50	1.4	80.4	14.9	3.3
—	Silty Sand	9.00	8.2	83.4	6.7	1.8
—	Silty Sand	10.50	2.5	89.3	6.0	2.2
—	Silty Sand	12.00	3.1	85.6	8.4	2.8
—	Silty Sand	13.50	2.6	81.9	13.1	2.4
—	Silty Sand	15.00	2.4	83.1	12.2	2.3

GRAIN SIZE ANALYSIS


BORE HOLE NO. BH - 2

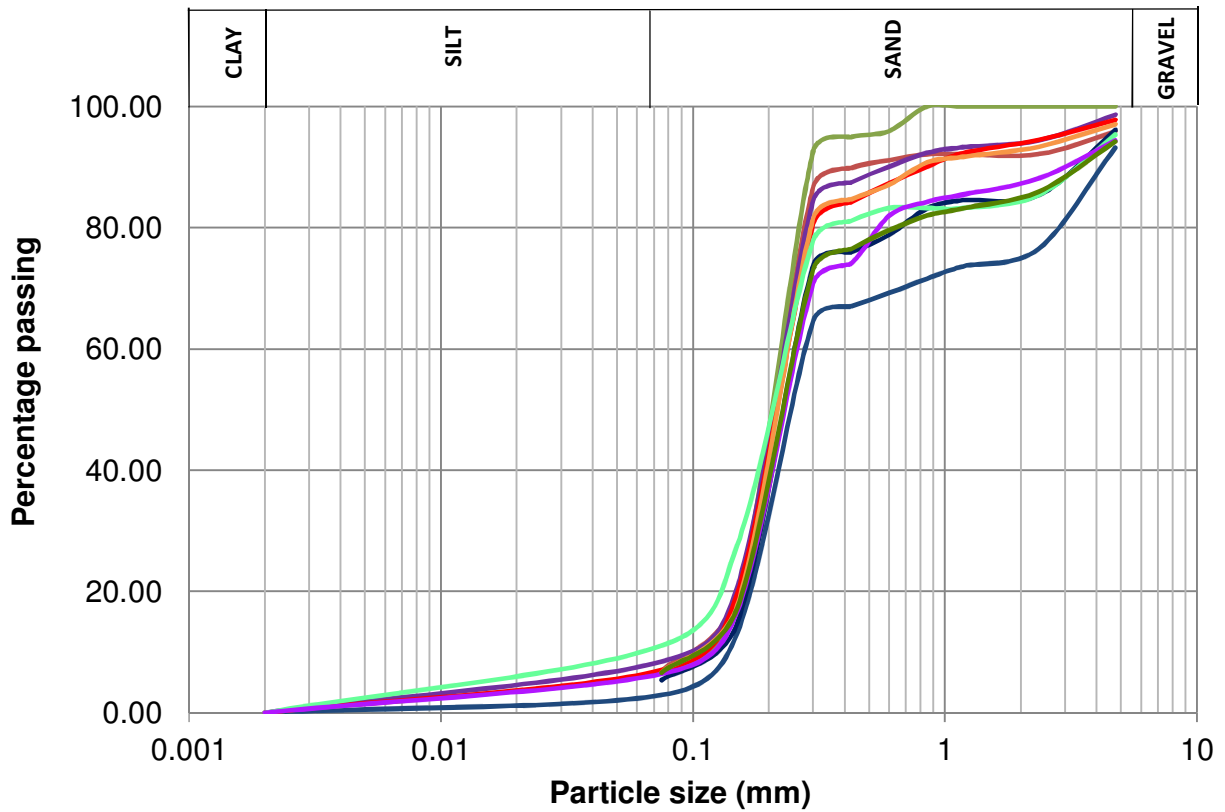

Symbol	Description	Depth (m)	Gravel (%)	Sand (%)	Silt (%)	Clay (%)
—	Silty Sand	1.50	6.8	80.0	10.3	2.9
—	Silty Sand	3.00	4.1	76.8	12.2	6.9
—	Silty Sand	4.50	0.0	81.2	12.0	6.8
—	Silty Sand	6.00	1.4	77.9	12.3	8.4
—	Silty Sand	7.50	2.2	78.1	12.7	7.0
—	Silty Sand	9.00	3.0	79.3	11.1	6.6
—	Silty Sand	10.50	3.9	81.3	9.4	5.4
—	Silty Sand	12.00	4.6	67.7	16.7	11.0
—	Silty Sand	13.50	5.6	77.6	10.3	6.4
—	Silty Sand	15.00	5.8	76.9	10.7	6.6

GRAIN SIZE ANALYSIS


BORE HOLE NO. BH - 3

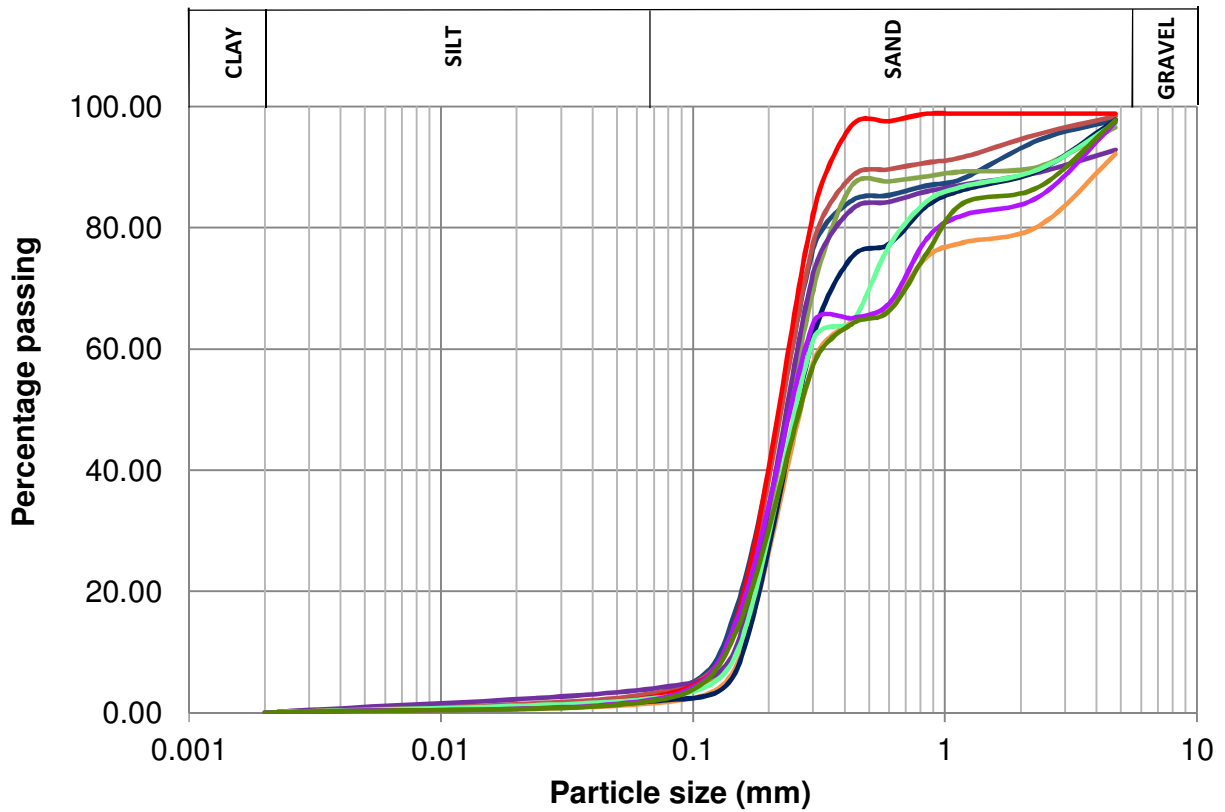


Symbol	Description	Depth (m)	Gravel (%)	Sand (%)	Silt (%)	Clay (%)
—	Silty Sand	1.50	2.2	80.0	14.4	3.3
—	Silty Sand	3.00	1.6	82.9	12.0	3.4
—	Silty Sand	4.50	3.4	85.7	8.6	2.3
—	Silty Sand	6.00	7.2	81.5	7.2	4.2
—	Silty Sand	7.50	1.2	82.9	13.0	2.9
—	Silty Sand	9.00	7.8	84.1	6.4	1.7
—	Silty Sand	10.50	2.2	90.4	5.3	2.0
—	Silty Sand	12.00	2.8	87.1	7.5	2.6
—	Silty Sand	13.50	2.6	81.9	13.1	2.4
—	Silty Sand	15.00	2.3	83.9	11.7	2.2

GRAIN SIZE ANALYSIS


BORE HOLE NO. BH - 4

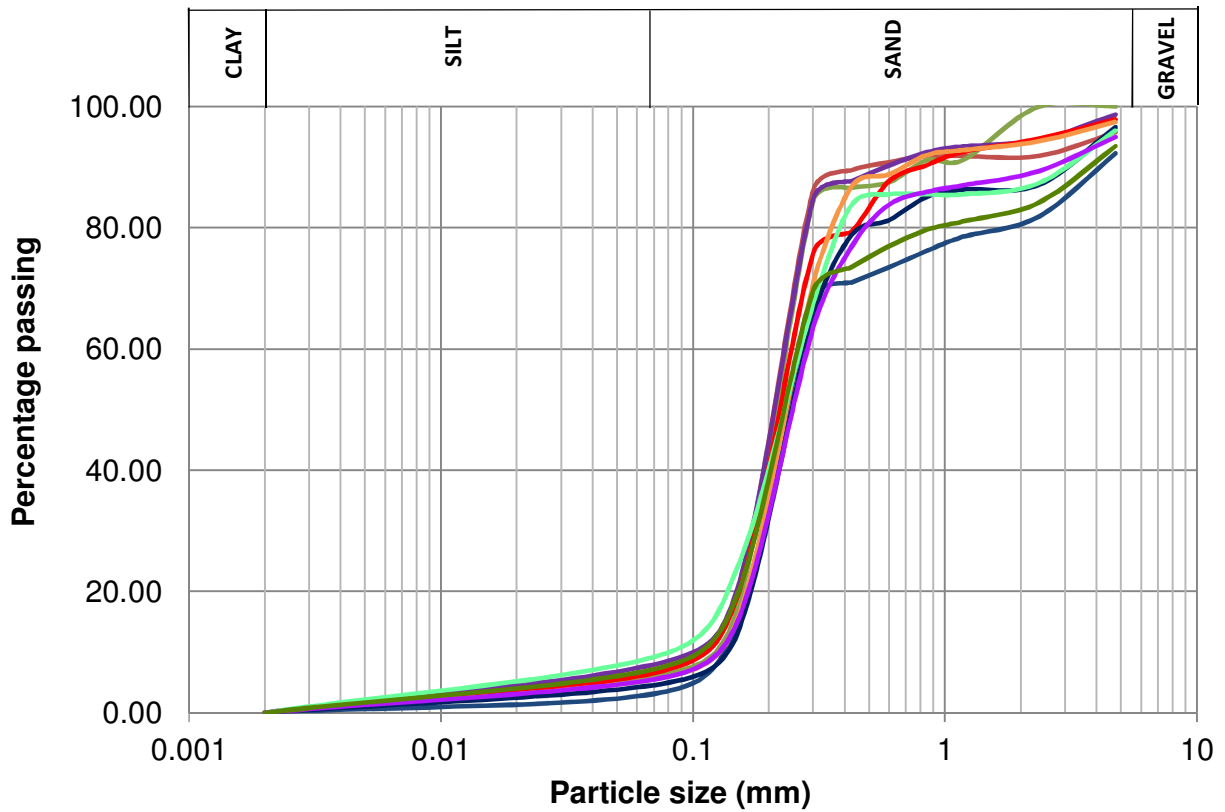

Symbol	Description	Depth (m)	Gravel (%)	Sand (%)	Silt (%)	Clay (%)
	Silty Sand	1.50	7.7	77.2	11.7	3.3
	Silty Sand	3.00	4.3	75.9	12.7	7.2
	Silty Sand	4.50	0.0	82.9	11.0	6.2
	Silty Sand	6.00	1.4	78.2	12.1	8.3
	Silty Sand	7.50	2.2	78.7	12.3	6.8
	Silty Sand	9.00	2.6	82.1	9.6	5.8
	Silty Sand	10.50	3.4	83.5	8.3	4.8
	Silty Sand	12.00	4.0	72.0	14.4	9.6
	Silty Sand	13.50	5.0	80.0	9.3	5.7
	Silty Sand	15.00	6.6	73.9	12.0	7.5

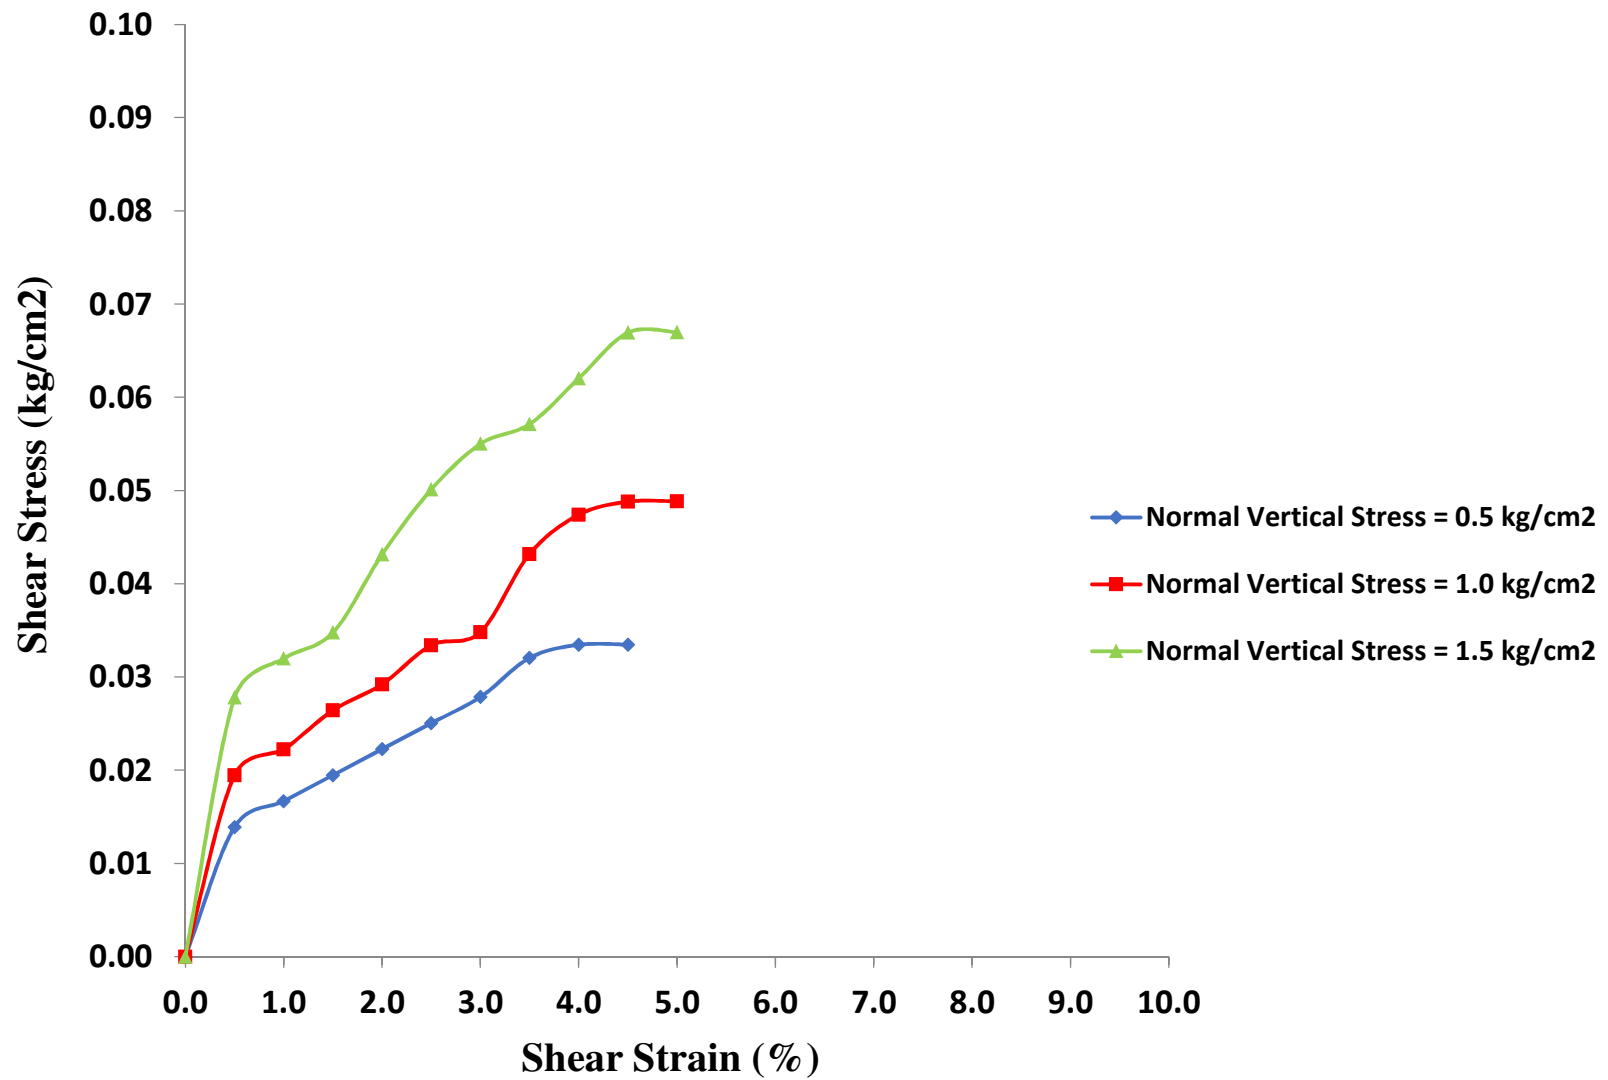


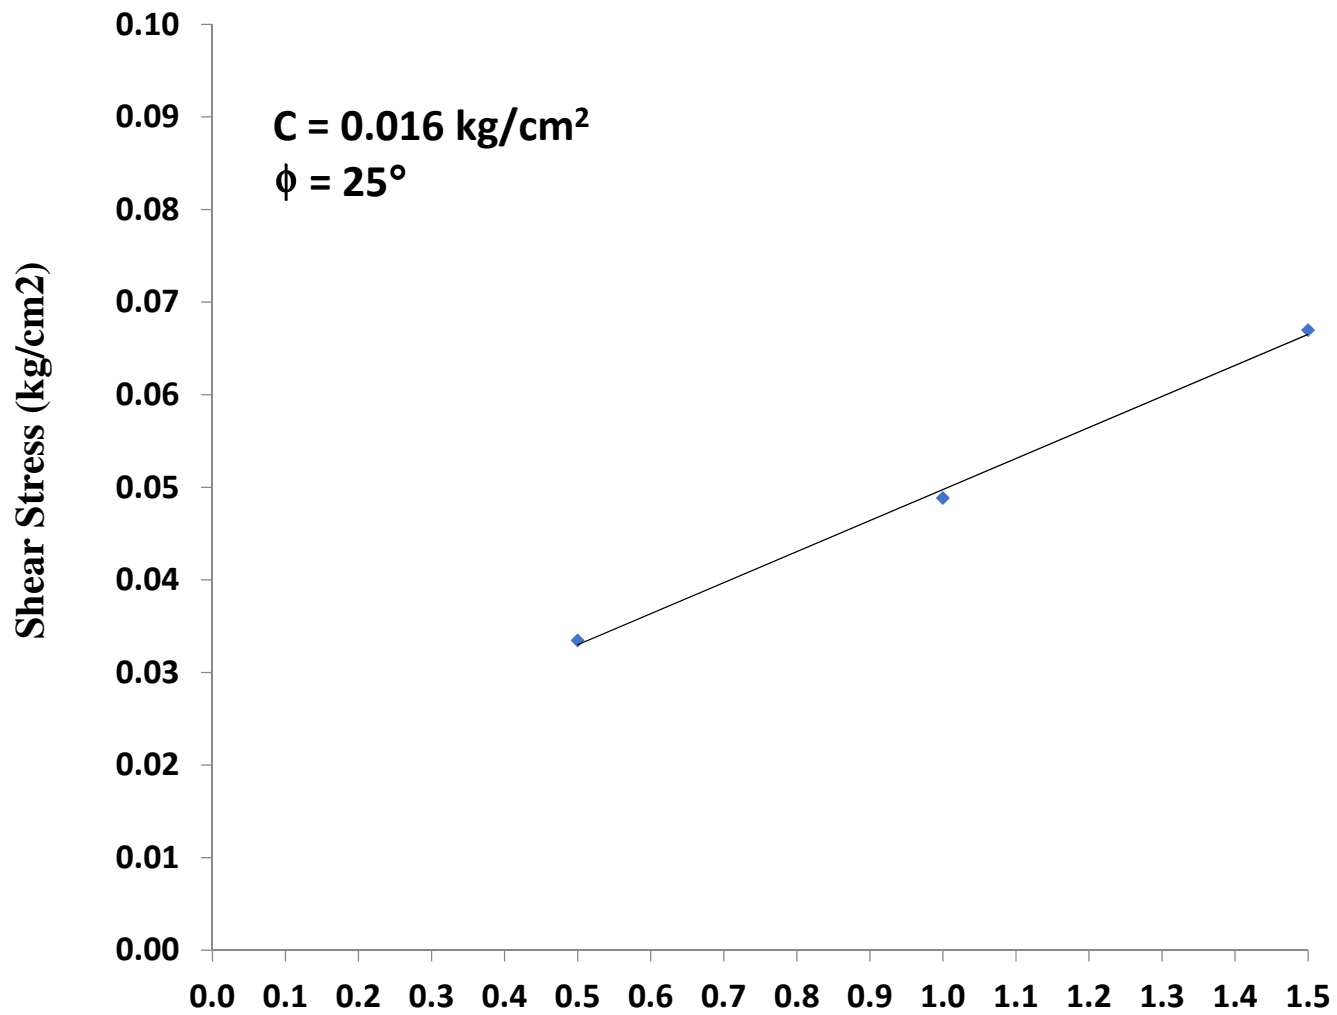


SHEAR STRESS-STRAIN CURVE



Normal Stress (kg/cm²)
FAILURE ENVELOP

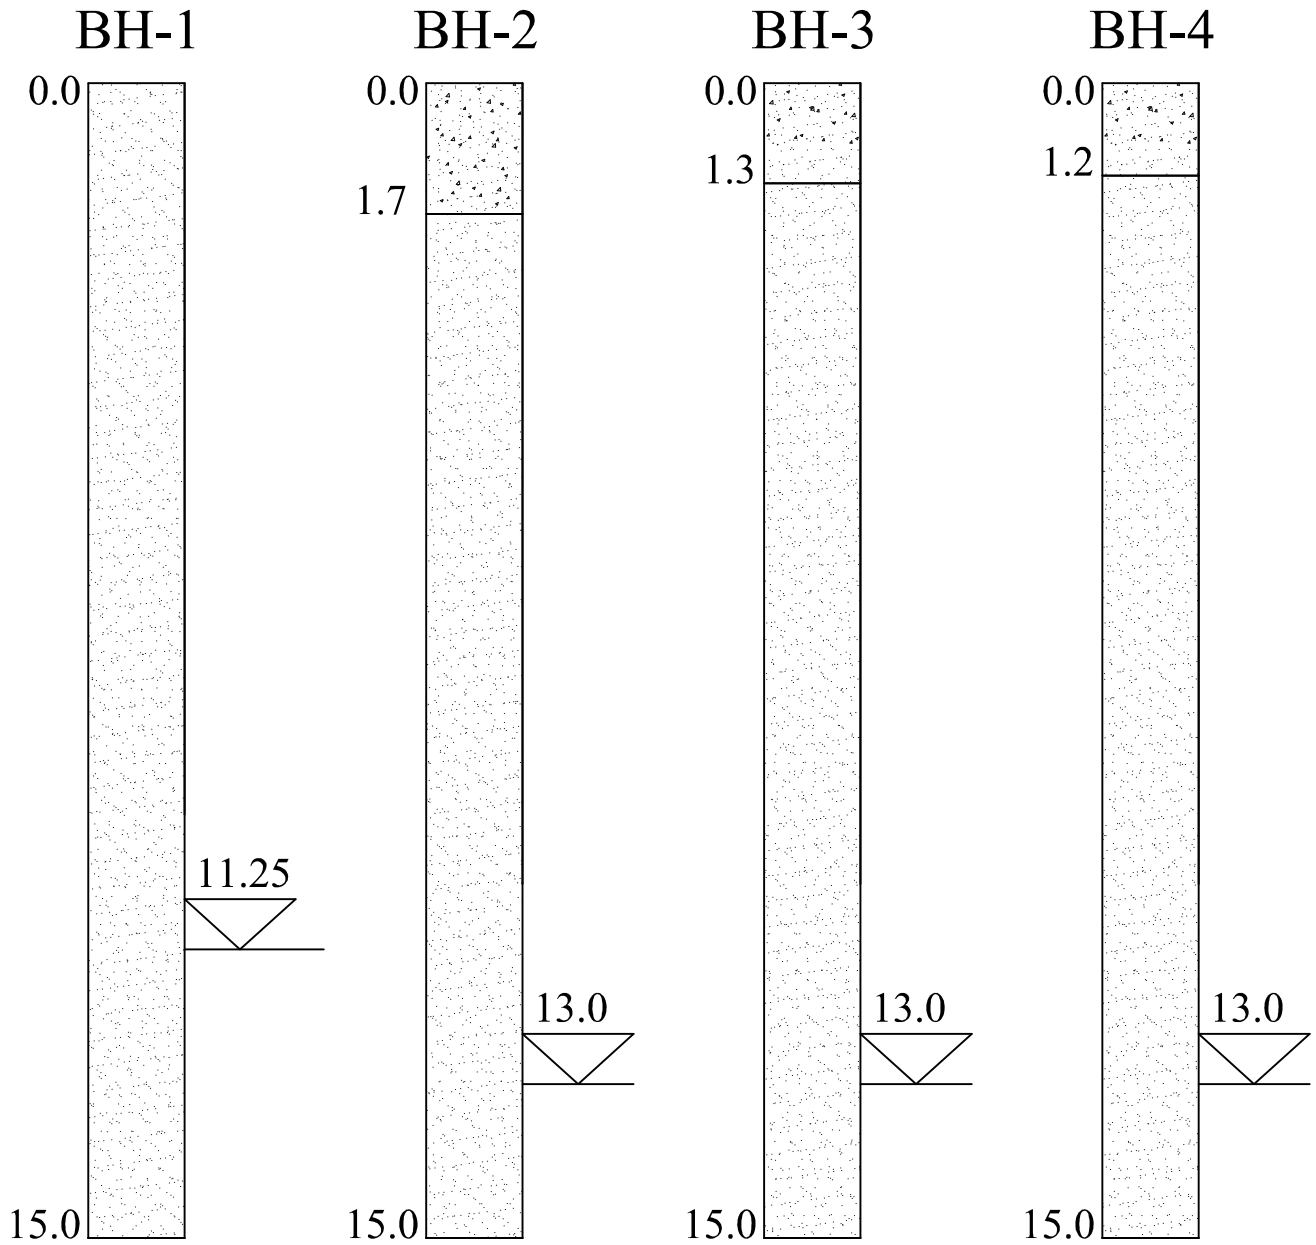Fig. A



LEGEND	
FILLED UP SOIL	
Silty Sand	
Water table	







APPENDIX – ‘A’

LIST OF REFERRED IS CODES

Field Investigation

1. IS: 1948-1970 Classification and identification of soils for general engineering purposes (first revision) Amendment 2
2. IS: 1892-1979 Code of practice for sub surface investigations for foundations
3. IS: 2131-1981 Method of standard penetration tests for soils
4. IS: 2132-1986 Code of practice for thin walled tube sampling of soils
5. IS: 6935: 1973 Method for determination of water level
6. IS: 3043-1987 Practice For Earthing

Laboratory tests

1. IS: 2720-1983 (Part 1) Methods of tests for soils: Preparation of dry soil samples for various tests (second revision)
2. IS: 2720-1980 (Part-2) Methods of test for soils: Determination of water content (second revision) Amendment 1
3. IS: 2720-1980 (Part-3/Sec 1) Method of test for soil: Determination of specificgravity: Fine grained soils
4. IS: 2720-1980 (Part-3/Sec 2) Method of test for soil: Determination of specificgravity:Fine, medium & coarse grained soils. (First revision)
5. IS: 2720-1985 (Part-4) Methods of test for soils: Grain size analysis (Second revision)
6. IS: 2720-1985 (Part-5) Methods of test for soils: Determination of liquid and plastic limit (Second revision)
7. IS: 2720 (Part-8) Determination of water content – dry density relation using heavy compaction. (First revision)
8. IS: 2720 (Part-10) Methods of test for soils: Determination of Shear strength Parameter using triaxial apparatus.
9. IS: 1498 - 1970 Classification and identification of soils for general engineering purposes.
10. IS: 3015-1987 Methods of Sampling and Test (Physical and Chemical) For Water and Wastewater


Foundation Construction

1. IS: 1080-1986Code of Practice for design and construction of shallow foundation on soils (other than raft, ring and shall) (Second revision)
2. IS: 1904-1986Code of Practice for design and construction offoundation in soils: First Revision (Amendment 1)
3. IS: 6403-1981 Code of Practice for determination of bearing capacity of shallow foundation: First revision (Amendment 1)
4. IS: 2911 (part-III) Code of Practice for Design and Construction of Pile Foundations.
5. IS: 2720(part 16)-1987 Laboratory Determination of CBR
6. IS: 8009 (part 2)-1980 Settlement for shallow &deep foundations
7. IS: 1893 (Part-1) Criteria for Earthquake Resistant Design of Structures
8. IS: 2950-1 (Part-1) Practice for design and construction of raft foundations, Design

**NAME OF WORK: GEOTECHNICAL SOIL
INVESTIGATION OF RAJOKARI VILLAGE (NEAR DESU
RAJOKARI)**

GEOTECHNICAL REPORT

CLIENT: -

	BSES RAJDHANI POWER LIMITED 1ST FLOOR; C-BLOCK, BSES BHAWAN, NEHRU PLACE DELHI, -110019. TELEPHONE: 91-011 -39999444
---	---

SOIL CONSULTANT:-


	M/S SWATI STRUCTURE SOLUTIONS PVT. LTD. KH NO.7/9, GROUND FLOOR, NANGLOI, JAT HARSUKH BLK, PREM NAGAR, DELHI- 110041
---	---



TABLE OF CONTENTS

Page No.

1.	Introduction	3
2.	Scope of Work	3
3.	Location of Bore Holes	3
4.	Field Investigation	4
5.	Ground Water Table	5
6.	Laboratory Tests	5
7.	Strength Characteristics of Soil	9
8.	Design Criteria	10
9.	Design Methodology	10
10.	Discussion on soil profile	12
11.	Chemical analysis	12
12.	Resistivity Test	13
13.	Bearing capacity	13
14.	Recommendations	14
15.	Closure	14
16.	Soil Profile	15
17.	Grain Size Analysis	19
18.	Results of Direct Shear Test	23
19.	Subsoil Profile (Fig. A)	25
20.	Site Photo	26
21.	List of Reference IS Codes	28



ABBREVIATION

BH	Borehole
ERT	Earth resistivity testing
IS	Indian standard
N Values	No of blows/30cm from standard penetration test
γ_d	Dry Density of Soil
N_m	Uncorrected SPT blow count
Q_{ab}	Allowable Net Bearing capacity
C	Cohesion in N/mm^2
B	Width of footing in m
D	Depth of Foundation in m
G	Specific Gravity
e	Void ratio
d_q, d_r, d_c	Depth factors
S_q, S_c, S_γ	Shape factors
I_q, I_r, I_c	Inclination factors
$N'_c, N'_q, N'_r,$	Bearing capacity factor
q	Total surcharge at the base level of foundation
W'	Water table correction factor
Φ	Angle of shearing resistance of soil
N_R	Recorded standard penetration value
N_C	Corrected standard penetration value
k	Modulus of sub-grade reaction
EGL	Existing Ground Level
Q_u	Ultimate bearing capacity
q_s	Safe Bearing Capacity



1.0 INTRODUCTION

The work of geotechnical investigation for Rajokari Village (Near DESU Rajokari). has been assigned to M/S Swati Structure Solutions Pvt. Ltd., having its address at KH No.7/9, Ground floor, Nangloi, Jat Harsukh BLK, Prem nagar, Delhi- 110041 by the BSES Rajdhani Power Limited with its address at 1st Floor; C-Block, BSES Bhawan, Nehru Place Delhi, -110019. The report presents the details of field investigation carried out in the month of January 2025 and the results are obtained from various fields and laboratory tests based on computation. Foundation analysis has been done and recommendation has been made as regards to suitable type of foundations to be provided for the proposed structure.

2.0 SCOPE OF WORK

- a) Mobilization and demobilization of all relevant men and machinery including all T&P required for carrying out soil investigation work as per direction of Engineer-in-charge.
- b) Drilling 4 Nos. Bore holes up to the depth of 20 or refusal whichever is earlier below the ground surface by shell and auger method.
- c) Conducting Standard Penetration Test at 1.50m regular interval as per Indian Standard Specification.
- d) Collection of disturbed and undisturbed soil samples from the bore holes at regular interval of 3.0m or change of strata.
- e) Carrying out lab test to find physical properties of sub soil strata.
- f) Recording of water table level in the bore hole after completion of bore hole.
- g) Preparation and submission of report incorporating all the data obtained from the field and laboratory tests.
- h) Evaluation of SBC based on shear & settlement Criteria.
- i) The field testing for bore holes has been done on 22/01/2025 to 25/01/2025

3.0 LOCATION OF BORE HOLES

Four nos. of bore holes are drilled at the proposed site. All the test locations are given by the client.



4.0 FIELD INVESTIGATION

4.1 Grain size distribution of soil at various depths has been carried out and grain size distribution curve is drawn. The soil type and shear parameters as obtained in the various bore-hole are given in the table below:

Bore Hole (BH) No.	Subsoil Layers	Soil Type	Shear Parameters	
			Cohesion c in Kg/cm ²	Action of friction (in Degree)
BH-1	Layer-1 (0.0m to 1.0m)	Filled up soil	-	-
	Layer-2 (1.0m to 20.0m)	Silty Sand	0.015	23 ⁰
BH-2	Layer-1 (0.0m to 0.5m)	Filled up soil	-	-
	Layer-2 (0.5m to 20.0m)	Silty Sand	0.015	23 ⁰
BH-3	Layer-1 (0.0m to 0.5m)	Filled up soil	-	-
	Layer-2 (0.5m to 20.0m)	Silty Sand	0.015	23 ⁰
BH-4	Layer-1 (0.0m to 1.2m)	Silty Sand	0.015	23 ⁰

4.2 Subsurface Exploration

Subsurface Exploration was carried out in 4 no. of bore hole at site using rotary drilling. The depth of bore- hole was taken from the existing ground surface.

4.3 Boring

The bore holes of 150 mm dia. were drilled by using rotary drilling method to collect soil sample up to the specified depth.

4.5 Standard Penetration Test (SPT)

Standard penetration tests as per IS: 2131-1981 was conducted at the bore hole, each at 1.5m interval or change of strata. The tests were performed by using a standard split spoon sampler attached to 'A' rod placed at the test level in the bore hole. The sampler was driven to a depth of 45cm by means of a standard hammer weighing 63.5 Kg. falling freely through a vertical height of 75 cm. Blows required for each 15 cm penetration (Total penetration 45cm) were recorded and the number of blows for last 30cm penetration of



the sampler was taken as N values. Blows for first 15 cm penetration of the sampler in each test, were discarded owing to the possible disturbance of the strata during auguring operations. The observed and the corrected N SPT values (IS: 2131-1981) are given with graphical representation on and soil profile.

5.0 GROUND WATER TABLE

Water table was not encountered in the bore hole.

6.0 LABORATORY TESTS

A visual and discrete examination of all the soil samples collected was carried out for deciding the number and type of tests as well as the number of samples to be tested from each bore hole. Based on the strata met at site the following tests were conducted on samples to classify them and to evaluate their index and Engineering properties

- a) Grain size distribution
- b) Bulk density and Moisture content
- c) Direct Shear Test
- d) Triaxial Tests
- e) Liquid limits and plastic limits
- f) Specific Gravity
- g) Chemical analysis of soil and water for chloride and sulphate content.
- h) Electrical resistivity test.

a) Grain Size Distribution

Grain size distribution of the soil is determined by sieving the soil sample in a set of IS sieves: 4.75mm, 2.36mm, 0.825mm, 0.6mm, 0.425mm, 0.30mm, 0.150mm, 0.075mm size. Grain Size Analysis curve has been plotted and attached in the appendices of this report for the soil samples collected from various depths of bore-holes.

b) Bulk Density And Natural Moisture Content

Undisturbed samples were collected from the boreholes in thin wall steel sample tubes by taking the dimensions and weight of these sample tubes, the bulk density of the soil is determined. Moisture content of the soil has been calculated by Oven Drying Method.



c) Direct Shear Test

A direct shear test is a laboratory or field test used by geotechnical engineers to measure the shear strength properties of soil or rock material, or of discontinuities in soil or rock masses. The test is performed on specimens from undisturbed soil sample. A specimen is placed in a shear box which has two stacked rings to hold the sample; the contact between the two rings is at approximately the mid-height of the sample. A confining stress is applied vertically to the specimen, and the upper ring is pulled laterally until the sample fails, or through a specified strain. The load applied and the strain induced is recorded at frequent intervals to determine a stress-strain curve for each confining stress. Several specimens are tested at varying confining stresses to determine the shear strength parameters, the soil cohesion (c) and the angle of internal friction (commonly friction angle) (ϕ). The results of the tests on each specimen are plotted on a graph with the peak (or residual) stress on the x-axis and the confining stress on the y-axis. The y-intercept of the curve which fits the test results is the cohesion, and the slope of the line or curve is the friction angle.

d) Triaxial Test

In this test undisturbed soil specimen is subjected to 3 compressive stresses at right angle to one another, horizontally confining constantly and the vertical stress is gradually increased until each specimen fails to evaluate cohesion and angle of shearing resistance. Triaxial shear tests have been performed by subjecting the cohesive-soil samples to major principal stresses in increase steps. The test specimen is allowed to consolidate under a number of successive increments of vertical pressure, each pressure increment being maintained constant until the deformation ceases, generally in 24 hours. The successive pressure employed are 0.10, 0.20, 0.40, 0.60, 0.80, 1.0, 1.5, 2.0, 2.5, 3.0, 3.5, 4.0 and 5.0 kg/cm². Thus, these stress increments are progressively carried-out until the failure of the specimen. The dial gauge readings for measuring the deformation are taken after the application of the pressure increment at the following total elapsed time of 0.25, 1.0, 4.0, 9.0, 16.0, 25.0, 36.0, 49.0, 64.0, 81 and 100 minutes until the consolidation is completed.



e) Atterberg Limits

Atterberg Limits in the form of liquid limit, plastic limit and shrinkage limit are determined for the soil to establish its consistency. In the case of cohesion less soil, plastic limit is first determined and if it cannot be determined the soil sample is reported to be non-plastic.

f) Specific Gravity

Specific Gravity of the soil has been determined by Specific Gravity Bottle.

g) Chemical analysis of soil and water for chloride and sulphate content.

- i. Heat the clean evaporating dish to 180°C for 1 hour. Cool in the desiccator, weigh and store in the desiccator until ready for use.
- ii. Filter a portion of the sample through any of the filters mentioned in 4.1, Select volume of the sample which has residue between 25 and 250 mg. preferably between 100 to 200 mg. This volume may be estimated from values of specific conductance. To obtain a measurable residue. Successive aliquots of filtered sample may be added to the sample dish,
- iii. Pipette this volume to a weighed evaporating dish placed on a-steam-bath. Evaporation may also be performed in a drying oven. The temperature shall be lowered to approximately 98°C to prevent boiling and splattering of the sample. After complete evaporation of water from the residue. Transfer the dish to an oven at 103-105°C or 179-181 °C and dry to constant mass, that is, till the difference in the successive weighings is less than 0-5 mg. Drying for a long duration (usually 1 to 2 hours) is done to eliminate necessity of checking for constant mass. The time for drying to constant mass with a given type of sample when a number of samples of nearly same type are to be analysed has to be determined by trial.
- iv. Weigh the dish as soon as it has cooled avoiding residue to stay for long time as some residues are hygroscopic and may absorb water from desiccant that is not absolutely dry.



h) Electrical resistivity test

The purpose of electrical resistivity survey is to determine the subsurface resistivity distribution by making measurements on the ground surface. From these measurements the true resistivity of the subsurface can be estimated against corrosion. The ground resistivity is related to various geological parameters, such as, the mineral and fluid Content, porosity and degree of water saturation in rock. Electrical resistivity surveys have been used for many decades in hydrogeological, mining and geotechnical investigations. More recently, it has been used for environmental surveys. It has the following other purposes:

- a) To rapidly explore the subsurface conditions in order to locate ground water, thickness of overburden, depth to different rock types and stratigraphic features.
- b) To delineate weak formations, faults and dykes, if any, and to identify location of steeply dipping contacts between different rock types and earth material.
- c) To delineate zones of seepage and identify its source around various structures of river valley projects.
- d) Assessment of groundwater potential, quality and determination of aquifer characteristics.
- e) To correlate data from resistivity survey with those obtained from borehole and trial pit logs.

For earthing of electrical conductors.

Range of Soil Resistivity (ohm-metres)	(Class of Soil)
Less than 25	Severely corrosive
25-50	Moderately corrosive
50-100	Mildly corrosive
Above 100	Very mildly corrosive



7.0 STRENGTH CHARACTERISTICS OF SOIL

The strength of a material is defined as the greatest stress it can sustain. If the stress exceeds strength, failure occurs. Strength analysis can be performed for tensile, compressive and shear stresses. Since soil mass has very little or negligible tensile strength, hence tensile strength analysis is rarely performed. Normally the geometry of most geotechnical problems is such that the soil mass is in compression, but do not fail in compression. Although the introduction of large compressive stresses may result in soil failure, the soil is actually failing in shear, not in compression. Therefore, nearly all geotechnical strength analysis is performed for shear stresses. The shear strength of a soil in any direction is the maximum shear stress that can be applied to the soil in that direction. It can also be defined as the resistance to deformation by continuous shear displacement of soil particles.

The shear strength of soil is basically made up of the following components:

(i) Frictional component:

It is mainly due to interlocking of soil particles and the friction between them.

(ii) Cohesion component:

It is due to mutual attraction that exists between the fine particles of some soils. The shear strength of cohesive soil results both from friction as well as cohesion whereas for cohesion-less soil it results from friction alone.

The shear strength equation was first proposed by French engineer Coulomb. He expressed the shear strength's' as a linear function of total normal stress ' σ ' on the potential surface of sliding

$$s = c + \sigma \tan (\phi)$$

Where s = shear strength

To assess the strength characteristics of soil at the proposed site 4 nos. of bore hole were drilled up to the depth mentioned in the bore log data. This Bore hole was advanced by Shell and Auger method up to the depth specified below the ground surface. While advancing the bore holes SPT tests were conducted at regular intervals of 1.5m depth and representative samples were collected and analyzed for soil classification. Water table was not encountered in the bore. The SPT values obtained have been corrected for overburden pressure. These corrected values have been plotted against depth and are shown in the respective bore log. It has been seen from the plots that the SPT values varying from 6 to 67 has been achieved for various bore holes and at various depth as shown in bore log plot between SPT value and depth. Direct Shear Tests were conducted on undisturbed soil samples collected at regular intervals of 3.0m for evaluating the shear parameters. The results are shown in the bore log.



8.0 DESIGN CRITERIA

Any foundation (shallow footing) is to be safe against possible failure against

- a) Excessive shear Failure (the bearing pressure should be within the permissible limits)
- b) Excessive settlement

The settlement depends not only on the type of soil below the foundation but also on the type of foundation, material used for construction and functionality of the structure.

9.0 DESIGN METHODOLOGY FOR SOIL

9.1 Raft foundation

Since the structure to be constructed on this site is 2B+G+3 framed structure Raft foundation has been analyzed, at a depth of 12.0m below EGL as required by the client on limited soil sample. An allowable settlement of 75mm settlement for raft footing has been considered as per IS: 1904 – 1986. The evaluation of SBC of foundation has been done using following two criteria

Shear Failure Criteria

The safe bearing pressure from interpolation of General & Local Shear failure criteria can be obtained, using the Equation given below

$$Q_{ab} = 0.67C N_c S_c d_c i_c + q (N_q - 1) s_q d_q i_q + 0.5 B \gamma N_r S_r d_r i_r W' \gamma$$

Where

C = cohesion in KN/m²

B = Width of the footing in m

d_q, d_y, d_c = Depth factors

S_q, S_y, S_c = Shape factors

I_q, I_y, I_c = Inclination factors

N'_q, N'_y, N'_c = Bearing capacity factor

q = Total surcharge at the base level of foundation

W' = Water table correction factor (Considered for flooding and heavy rain)

γ = Bulk unit wt. of foundation soil, in KN/m³

a) Settlements:

- i) Soil profile is given for each bore hole. The Soil profile which is likely to cause greater settlements is to be considered for calculations.
- ii) The imposed load at the foundation level is likely to compress the soil up to the depth of approximately equal to 1.5B below the foundations.
- iii) The settlements can be calculated using IS-8009 part-I & II.



SAMPLE CALCULATION FOR RAFT FOUNDATION 12.0M DEPTH FOR SHEAR CRITERIA

SAFE BEARING CAPACITY		
Symbol	Description	Value
C	Cohesion	1.5 KN/m ²
ϕ	Angle of shearing resistance of soil in degrees	23
ϕ_m	Angle of shearing resistance of soil in degrees [$\tan^{-1}(0.67(\tan \phi))$]	15.88
G	Specific Gravity	2.65
γ_d	Dry Density of Soil	15.20
e	Void ratio [$(G\gamma_w/\gamma_d)-1$]	0.74
Interpolation of Bearing Capacity Factor		
N' _c	Bearing Capacity Factor (Local Shear)	11.99
N' _q	Bearing Capacity Factor (Local Shear)	4.60
N' _r	Bearing Capacity Factor (Local Shear)	3.41
	Shape of Base	Square
S _c	Shape Factor (Square)	1.30
S _q	Shape Factor (Square)	1.20
S _r	Shape Factor (Square)	0.80
D	Depth of Foundation	12
B	Width of Foundation	10
N ϕ	$\tan^2(\pi/4 + \phi/2)$	0.024
d _c	Depth Factors (1 + 0.2 Dt/BVN ϕ)	1.04
i _c	Inclination Factors	1
i _q	Inclination Factors	1
i _r	Inclination Factors	1
γ	Density at Foundation Level	17.50 KN/m ³
q	Total surcharge at the base level of foundation ($\gamma \times D$)	210.00 KN/m ³
d _q = d _r	Depth Factors (1 for $\phi < 10^\circ$)	-
d _q = d _r	Depth Factors (1+0.1 Dt/B $\sqrt{N\phi}$ for $\phi < 10^\circ$)	1.018
R _{w1}	Reduction Factor	0.5
Q _u	Ultimat bearing capacity of Foundation	Q _u = 0.5 C N _c S _c d _c i _c + q (N _q -1) s _q d _q i _q + 0.5 B γ N _r S _r d _r i _r R _{w1}
Q_u	Ultimat bearing capacity of Foundation	1058 KN/m²
FS	Factor of Safety	3
q_s	Q_u/FS	353 KN/m²
	Allowable Bearing Capacity of Foundation	35 KN/m²



SAMPLE CALCULATION FOR RAFT FOUNDATION 12.0M DEPTH FOR SETTLEMENTS CRITERIA

SETTLEMENT CONSIDERATION AS PER IS: 8009 Part I (Fig. 9) (AT THE DEPTH OF 12.0M FROM E.G.L.)		
N _R	N Value Recorded at a depth of 12.0m	24.0
N _C	N Value Corrected at a depth of 12.0m	19.5
B	Width of Footing	10.0 m
	Permissible Settlement As Per IS: 8009 Part I(Fig. 9)	75 mm
	Settlement by applying 1kg/sqcm pressure as per IS:8009-I - 1976	18.0 mm
	Corrected settlement by applying W' (RW) for 1 kg/cm ²	18.0 mm
	Pressure allowed for 75mm settlement (75/corr. Settlement)	4.167
	Bearing Capacity of Foundation	41.67 t/m²
	Allowable Bearing Capacity of Foundation	41.67 t/m²

10.0 DISCUSSION ON SOIL PROFILE

Results of field and laboratory tests indicate that the soil strata in all bore holes filled up soil up to a maximum depth of 1.0m. Below 1.0m soil strata is Silty Sand up to the depth of exploration (20m). Bore log data of various bore holes are shown in Fig. A.

11.0 CHEMICAL ANALYSIS OF SOIL AND WATER (BIS CODE IS: 456-2000)

S. No	Test Parameters	Test Method	Requirements As per IS:10500-2012	Results
			Acceptable Limit	
1.	Colour, Hazen units	IS:3025 (Part-4)1983	5.0 Max	3.98
2.	Odour	IS:3025 (Part-5)1983	Agreeable	Agreeable
3.	pH value	IS:3025 (Part-11)1983	6.5 to 8.5	8.2
4.	Taste	IS:3025 (Part-7&8)1984	Agreeable	Agreeable
5.	Turbidity, NTU	IS:3025 (Part-10)1984	1.0 Max	0.72
6.	Total Dissolved solids, mg/l	IS:3025 (Part-16)1984	500 Max	502.6
7.	Fluoride, (as F) mg/l	IS:3025 (Part-10)1984	1.0 Max	0.52
8.	Sulphate, (as SO ₄) mg/l	IS:3025 (Part-24)1986	200.0 Max	186.4
9.	Iron, (as Fe). mg/l	IS:3025 (Part-53) 2003	0.30 Max	0.26
10.	Chloride (as Cl) mg/l	IS:3025 (Part-32)1988	250 Max	182.8
11.	Total Hardness ca (as CaCO ₃), mg/l	IS:3025 (Part-40)1991	200 Max	142.5
12.	Total Alkalinity, mg/l	IS:3025 (Part-23)1986	200 Max	159.6



12.0 RESULTS OF ELECTRICAL RESISTIVITY TEST (IS CODE: 3043 – 1987)

EARTH RESISTIVITY TEST								
PROJECT:-	GEOTECHNICAL SOIL INVESTIGATION OF RAJOKARI VILLAGE (NEAR DSEU RAJOKARI)							
LOCATION:-	NEW DELHI (Location -01)							
DATE OF TESTING:-	22.01.2025							
RESULTS								
DIRECTION	NORTH (1)		SOUTH (2)		EAST (3)		WEST (4)	
PROBE DISTANCE "S" (M)	MEGGER READING "R" (Ω)	RESISTIVITY (Ω -M) $\rho = 2 \times 3.14 \times S \times R$	MEGGER READING "R" (Ω)	RESISTIVITY (Ω -M) $\rho = 2 \times 3.14 \times S \times R$	MEGGER READING "R" (Ω)	RESISTIVITY (Ω -M) $\rho = 2 \times 3.14 \times S \times R$	MEGGER READING "R" (Ω)	RESISTIVITY (Ω -M) $\rho = 2 \times 3.14 \times S \times R$
0.5	1.4	4.40	1.64	5.15	1.72	5.40	1.56	4.90
1	1.58	9.92	1.56	9.80	1.68	10.55	1.72	10.80
2	1.62	20.35	1.76	22.11	1.70	21.35	1.62	20.35
3	1.56	29.39	1.56	29.39	1.72	32.40	1.6	30.14
DIRECTION		AVERAGE RESISTIVITY (Ω-M)						
NORTH (1)		16.01						
SOUTH (2)		16.61						
EAST (3)		17.43						
WEST (4)		16.55						
Average Resistivity =		16.65						

13.0 BEARING CAPACITY

13.1 FROM SHEAR CRITERIA

RAFT FOUNDATION

Depth of raft Foundation (m)	Size of Raft footing (m)	Net Allowable Bearing Capacity (T/Sq.M)
12.0	10 = >	35.0



13.2 FROM SETTLEMENT CRITERIA

RAFT FOUNDATION

Depth of raft Foundation (m)	Size of Raft footing (m)	Net Allowable Bearing Capacity (T/Sq.M)
12.0	10 = >	41.67

14.0 RECOMMENDATIONS

RAFT FOUNDATION

Depth of raft Foundation (m)	Size of Raft footing (m)	Net Allowable Bearing Capacity (T/Sq.M)
12.0	10 = >	35.0

1. However since only limited bore holes have been done, the net safe bearing capacity shall be limited as 30 T/sqm for all design purpose for design of foundation.
2. Modulus of Subgrade Reaction: The Modulus of soil Subgrade reaction shall be taken as 10510. Kn/m³ at a depth of 12.0m for design of raft foundation.


NOTE:-

1. If any loose pockets are observed during excavation for foundation, the same shall be filled with PCC 1:5:10. Foundation can subsequently be placed over this prepared surface.
2. If the profile of soil at any location defers from what is shown, the same shall be brought in notice of soil consultant before laying any foundation.

15.0 CLOSURE

We appreciate the opportunity to perform this investigation for you and have pleasure in submitting this report. Please contact us when we can be of further service to you.

For Swati Structure Solutions Pvt. Ltd



Er. Shubham Ojha


**SWATI STRUCTURE SOLUTIONS PVT.
LTD.**

S.P.T. PLOT
Observed 
Corrected 

PROJECT: GEOTECHNICAL SOIL INVESTIGATION OF RAJOKARI VILLAGE (NEAR DESU RAJOKARI)

SHEET NO 15

N Values	N Values Corrected	DEPTH (m)	Type of Sample	Soil Classification
		0.50	DS-1	Silty Sand
6	6	1.95	SPT-1	
		2.80	UDS-1	
14	14	3.45	SPT-2	
11	11	4.95	SPT-3	
		5.80	UDS-2	
13	13	6.45	SPT-4	
14	14	7.95	SPT-5	
		8.80	UDS-3	
18	17	9.45	SPT-6	
21	18	10.95	SPT-7	
		11.80	UDS-4	
24	20	12.45	SPT-8	
28	22	13.95	SPT-9	
		14.80	UDS-5	
35	25	15.45	SPT-10	
40	28	16.95	SPT-11	
		17.80	UDS-6	
0	0	18.45	SPT-12	
0	0	19.95	SPT-13	

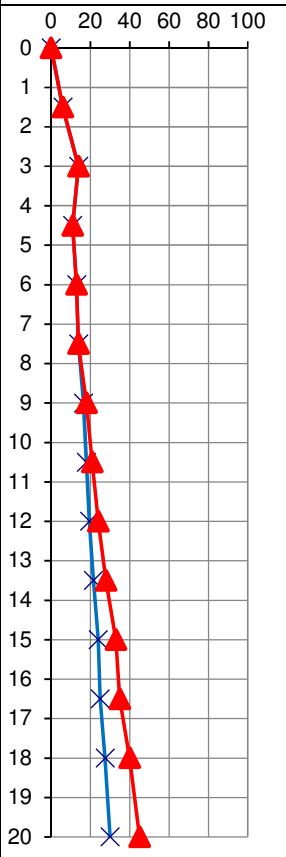

BOREHOLE NO				TERMINAL DEPTH (m)					Water Table			
BH 1				20.0 meter					Nil			
GRAIN SIZE ANALYSIS				LIQUID LIMIT	PLASTIC LIMIT	DRY DENSITY	BULK DENSITY	MOIST. CONT.	SHEAR PARAMETER			Sp. Gr.
GRAVEL %	SAND %	SILT %	CLAY %	%	%	gm/cc	gm/cc	%	TEST TYPE	C Kg/cm ²	f deg.	
2.8	76.9	17.1	3.2	15	NP							
						1.54	1.75	14	UU	0.015	23	2.65
1.5	80.9	15.0	2.6	16	NP							
2.0	82.9	12.6	2.4	21	NP							
						1.48	1.75	18	UU	0.015	23	2.65
0.0	84.6	11.5	3.9	17	NP							
0.0	75.1	18.6	6.3	15	NP							
						1.50	1.75	17	UU	0.015	23	2.66
0.0	78.7	15.6	5.7	16	NP							
0.0	82.2	11.9	5.9	17	NP							
						1.47	1.76	20	UU	0.015	23	2.65
0.0	82.1	10.9	7.0	18	NP							
0.0	80.7	12.5	6.7	16	NP							
						1.48	1.75	18	UU	0.015	23	2.66
0.0	82.5	14.6	2.9	20	NP							
0.0	85.7	12.0	2.3	20	NP							
						1.48	1.76	19	UU	0.015	23	2.67
0.0	86.6	11.2	2.2	21	NP							
0.0	87.8	9.6	2.6	20	NP							


**SWATI STRUCTURE SOLUTIONS PVT.
LTD.**

S.P.T. PLOT
Observed ▲
Corrected ×

PROJECT: GEOTECHNICAL SOIL INVESTIGATION OF RAJOKARI VILLAGE (NEAR DESU RAJOKARI)

SHEET NO 16

N Values	N Values Corrected	DEPTH (m)	Type of Sample	Soil Classification
		0.50	DS-1	Silty Sand
6	6	1.95	SPT-1	
		2.80	UDS-1	
14	14	3.45	SPT-2	
11	11	4.95	SPT-3	
		5.80	UDS-2	
13	13	6.45	SPT-4	
14	14	7.95	SPT-5	
		8.80	UDS-3	
18	17	9.45	SPT-6	
21	18	10.95	SPT-7	
		11.80	UDS-4	
24	20	12.45	SPT-8	
28	22	13.95	SPT-9	
		14.80	UDS-5	
35	25	15.45	SPT-10	
40	28	16.95	SPT-11	
		17.80	UDS-6	
0	0	18.45	SPT-12	
0	0	19.95	SPT-13	

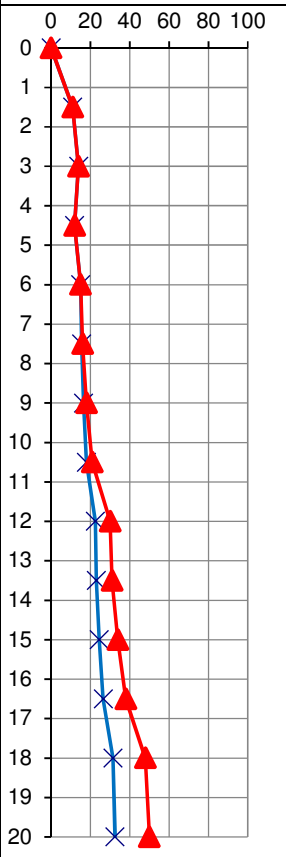

BOREHOLE NO				TERMINAL DEPTH (m)					Water Table			
BH 2				20.0 meter					Nil			
GRAIN SIZE ANALYSIS				LIQUID LIMIT	PLASTIC LIMIT	DRY DENSITY	BULK DENSITY	MOIST. CONT.	SHEAR PARAMETER			Sp. Gr.
GRAVEL %	SAND %	SILT %	CLAY %	%	%	gm/cc	gm/cc	%	TEST TYPE	C Kg/cm ²	f deg.	
3.7	80.1	10.8	5.4	14	NP							
						1.52	1.75	15	UU	0.015	23	2.65
3.9	76.6	13.0	6.4	17	NP							
3.1	74.6	17.6	4.7	22	NP							
						1.49	1.74	17	UU	0.015	23	2.66
0.0	82.1	13.6	4.3	20	NP							
0.0	82.2	12.8	5.0	18	NP							
						1.51	1.74	15	UU	0.015	23	2.65
0.0	77.4	17.1	5.5	21	NP							
1.1	81.2	12.0	5.6	18	NP							
						1.47	1.75	19	UU	0.015	23	2.65
0.0	84.0	9.7	6.2	20	NP							
0.0	83.5	10.7	5.8	17	NP							
						1.46	1.75	20	UU	0.015	23	2.65
0.0	85.3	12.3	2.4	21	NP							
0.0	87.5	10.4	2.0	18	NP							
						1.49	1.76	18	UU	0.015	23	2.66
0.0	89.0	9.2	1.8	21	NP							
0.0	85.5	11.4	3.1	21	NP							


**SWATI STRUCTURE SOLUTIONS PVT.
LTD.**

S.P.T. PLOT
Observed 
Corrected 

PROJECT: GEOTECHNICAL SOIL INVESTIGATION OF RAJOKARI VILLAGE (NEAR DESU RAJOKARI)

SHEET NO 18


N Values	N Values Corrected	DEPTH (m)	Type of Sample	Soil Classification
		0.50	DS-1	Silty Sand
6	6	1.95	SPT-1	
		2.80	UDS-1	
14	14	3.45	SPT-2	
11	11	4.95	SPT-3	
		5.80	UDS-2	
13	13	6.45	SPT-4	
14	14	7.95	SPT-5	
		8.80	UDS-3	
18	17	9.45	SPT-6	
21	18	10.95	SPT-7	
		11.80	UDS-4	
24	20	12.45	SPT-8	
28	22	13.95	SPT-9	
		14.80	UDS-5	
35	25	15.45	SPT-10	
40	28	16.95	SPT-11	
		17.80	UDS-6	
0	0	18.45	SPT-12	
0	0	19.95	SPT-13	

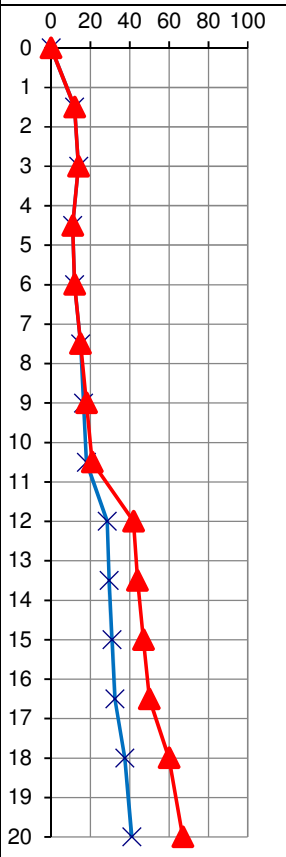

BOREHOLE NO				TERMINAL DEPTH (m)					Water Table			
BH 4				20.0 meter					Nil			
GRAIN SIZE ANALYSIS				LIQUID LIMIT	PLASTIC LIMIT	DRY DENSITY	BULK DENSITY	MOIST. CONT.	SHEAR PARAMETER			Sp. Gr.
GRAVEL %	SAND %	SILT %	CLAY %	%	%	gm/cc	gm/cc	%	TEST TYPE	C Kg/cm ²	f deg.	
2.8	77.1	16.9	3.2	15	NP							
						1.52	1.75	15	UU	0.015	23	2.65
1.2	85.0	11.8	2.0	17	NP							
1.8	85.2	11.0	2.1	18	NP							
						1.50	1.76	17	UU	0.015	23	2.65
0.0	86.3	10.2	3.5	20	NP							
0.0	77.4	14.5	8.1	18	NP							
						1.49	1.76	18	UU	0.015	23	2.65
0.0	79.1	12.5	8.4	17	NP							
0.0	82.4	11.8	5.9	18	NP							
						1.45	1.75	21	UU	0.015	23	2.66
0.0	82.7	10.6	6.7	16	NP							
0.0	82.4	11.5	6.2	18	NP							
						1.47	1.76	20	UU	0.015	23	2.65
0.0	87.4	10.6	2.1	19	NP							
0.0	83.4	13.9	2.7	21	NP							
						1.50	1.75	17	UU	0.015	23	2.67
0.0	80.4	15.7	3.9	20	NP							
0.0	87.2	9.5	3.3	21	NP							

GRAIN SIZE ANALYSIS


BORE HOLE NO. BH - 1

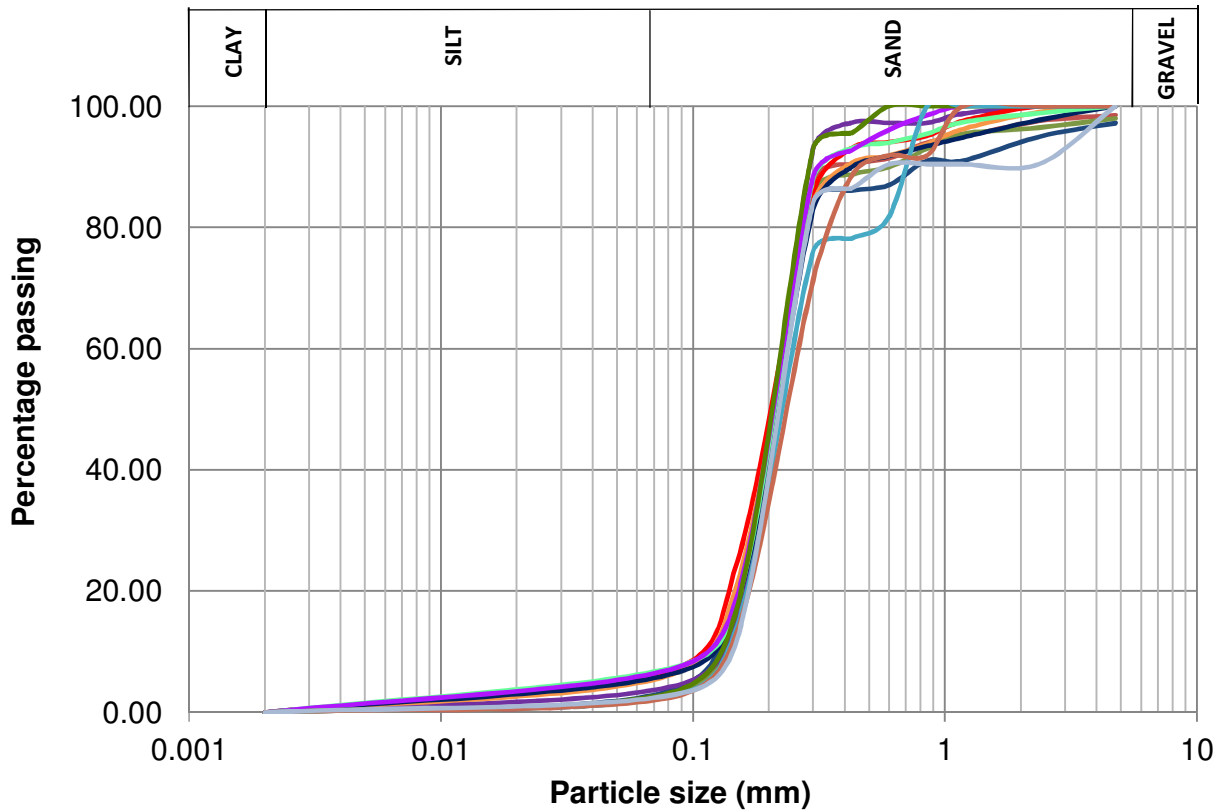

Symbol	Description	Depth (m)	Gravel (%)	Sand (%)	Silt (%)	Clay (%)
—	Silty Sand	1.50	2.8	76.9	17.1	3.2
—	Silty Sand	3.00	1.5	80.9	15.0	2.6
—	Silty Sand	4.50	2.0	82.9	12.6	2.4
—	Silty Sand	6.00	0.0	84.6	11.5	3.9
—	Silty Sand	7.50	0.0	75.1	18.6	6.3
—	Silty Sand	9.00	0.0	78.7	15.6	5.7
—	Silty Sand	10.50	0.0	82.2	11.9	5.9
—	Silty Sand	12.00	0.0	82.1	10.9	7.0
—	Silty Sand	13.50	0.0	80.7	12.5	6.7
—	Silty Sand	15.00	0.0	82.5	14.6	2.9
—	Silty Sand	16.50	0.0	85.7	12.0	2.3
—	Silty Sand	18.00	0.0	86.6	11.2	2.2
—	Silty Sand	20.00	0.0	87.8	9.6	2.6

GRAIN SIZE ANALYSIS


BORE HOLE NO. BH - 2

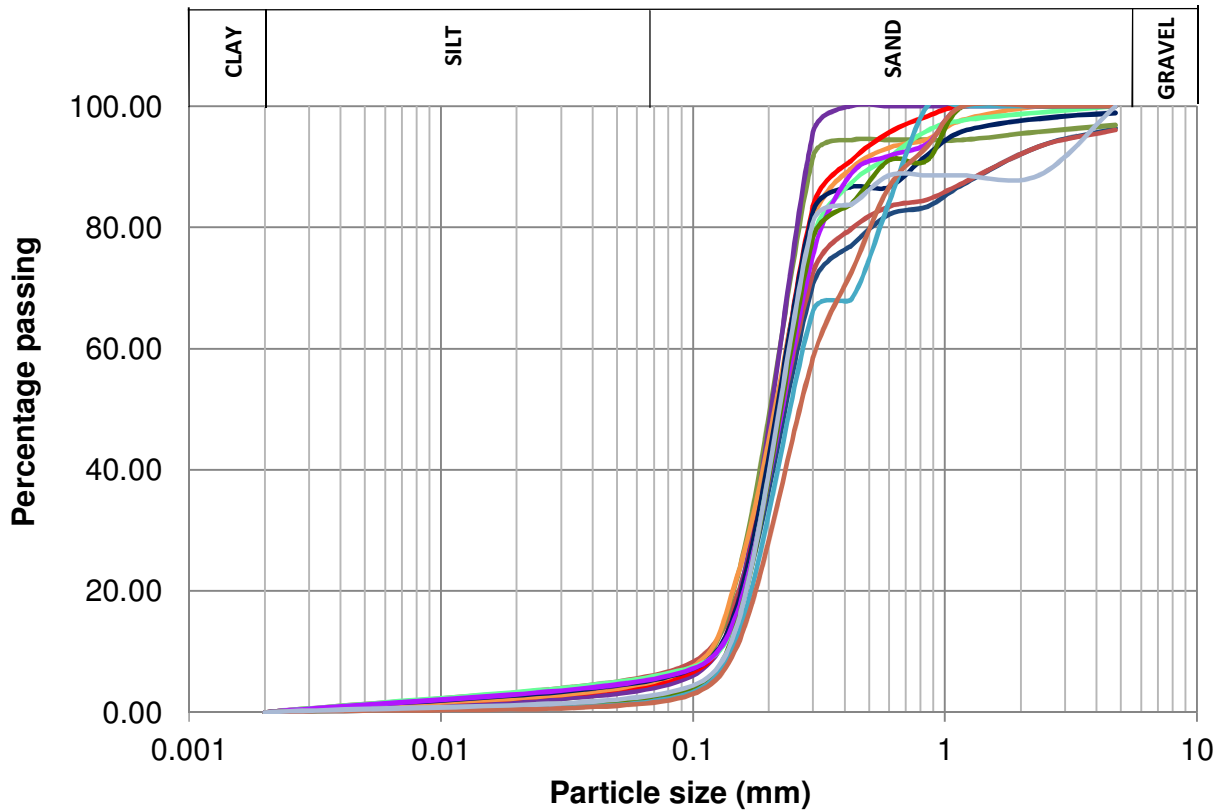

Symbol	Description	Depth (m)	Gravel (%)	Sand (%)	Silt (%)	Clay (%)
—	Silty Sand	1.50	3.7	80.1	10.8	5.4
—	Silty Sand	3.00	3.9	76.6	13.0	6.4
—	Silty Sand	4.50	3.1	74.6	17.6	4.7
—	Silty Sand	6.00	0.0	82.1	13.6	4.3
—	Silty Sand	7.50	0.0	82.2	12.8	5.0
—	Silty Sand	9.00	0.0	77.4	17.1	5.5
—	Silty Sand	10.50	1.1	81.2	12.0	5.6
—	Silty Sand	12.00	0.0	84.0	9.7	6.2
—	Silty Sand	13.50	0.0	83.5	10.7	5.8
—	Silty Sand	15.00	0.0	85.3	12.3	2.4
—	Silty Sand	16.50	0.0	87.5	10.4	2.0
—	Silty Sand	18.00	0.0	89.0	9.2	1.8
—	Silty Sand	20.00	0.0	85.5	11.4	3.1

GRAIN SIZE ANALYSIS


BORE HOLE NO. BH - 3

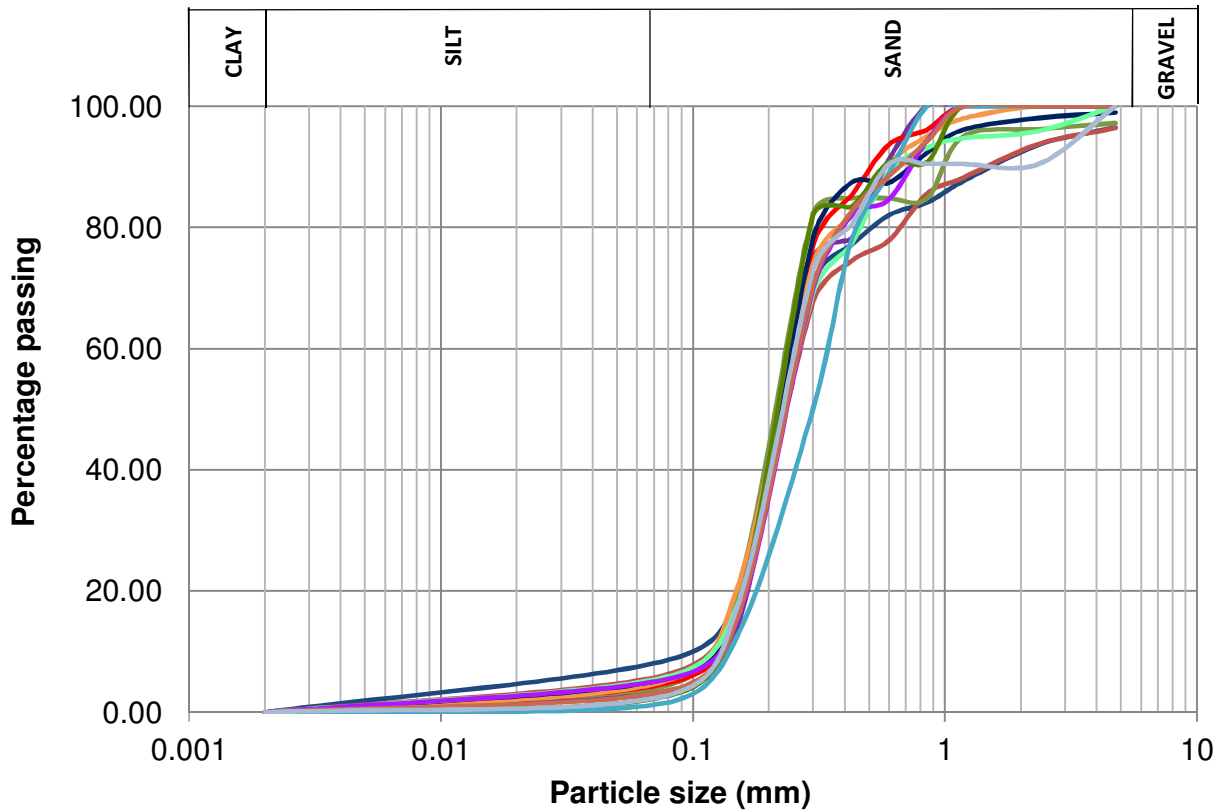


Symbol	Description	Depth (m)	Gravel (%)	Sand (%)	Silt (%)	Clay (%)
—	Silty Sand	1.50	3.5	77.7	10.4	8.4
—	Silty Sand	3.00	3.7	78.2	12.1	6.0
—	Silty Sand	4.50	2.8	77.2	15.8	4.2
—	Silty Sand	6.00	0.0	86.0	10.7	3.4
—	Silty Sand	7.50	0.0	83.6	11.8	4.6
—	Silty Sand	9.00	0.0	79.4	15.6	5.0
—	Silty Sand	10.50	1.1	82.2	11.4	5.3
—	Silty Sand	12.00	0.0	82.3	12.0	5.7
—	Silty Sand	13.50	0.0	84.8	9.9	5.3
—	Silty Sand	15.00	0.0	83.5	14.0	2.5
—	Silty Sand	16.50	0.0	87.4	11.2	1.4
—	Silty Sand	18.00	0.0	84.4	12.2	3.3
—	Silty Sand	20.00	0.0	82.5	14.9	2.6

GRAIN SIZE ANALYSIS


BORE HOLE NO. BH - 4

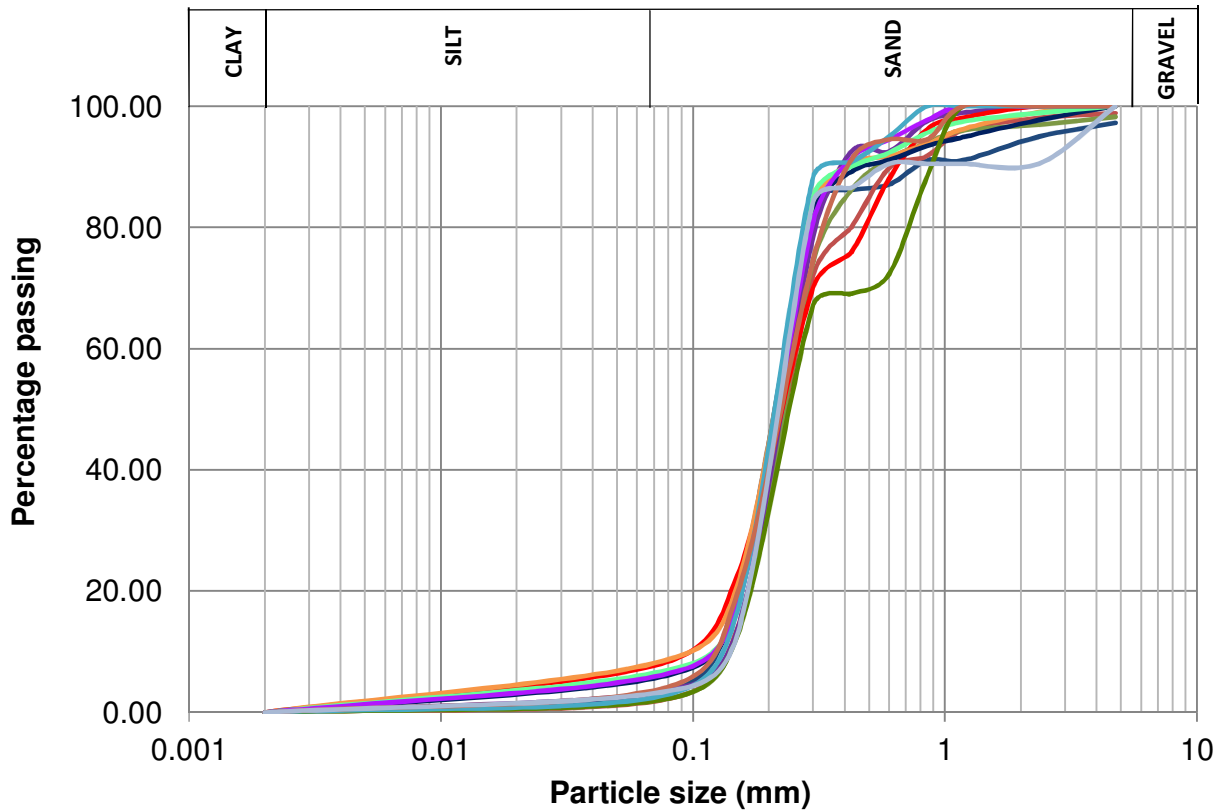

Symbol	Description	Depth (m)	Gravel (%)	Sand (%)	Silt (%)	Clay (%)
	Silty Sand	1.50	2.8	77.1	16.9	3.2
	Silty Sand	3.00	1.2	85.0	11.8	2.0
	Silty Sand	4.50	1.8	85.2	11.0	2.1
	Silty Sand	6.00	0.0	86.3	10.2	3.5
	Silty Sand	7.50	0.0	77.4	14.5	8.1
	Silty Sand	9.00	0.0	79.1	12.5	8.4
	Silty Sand	10.50	0.0	82.4	11.8	5.9
	Silty Sand	12.00	0.0	82.7	10.6	6.7
	Silty Sand	13.50	0.0	82.4	11.5	6.2
	Silty Sand	15.00	0.0	87.4	10.6	2.1
	Silty Sand	16.50	0.0	83.4	13.9	2.7
	Silty Sand	18.00	0.0	80.4	15.7	3.9
	Silty Sand	20.00	0.0	87.2	9.5	3.3

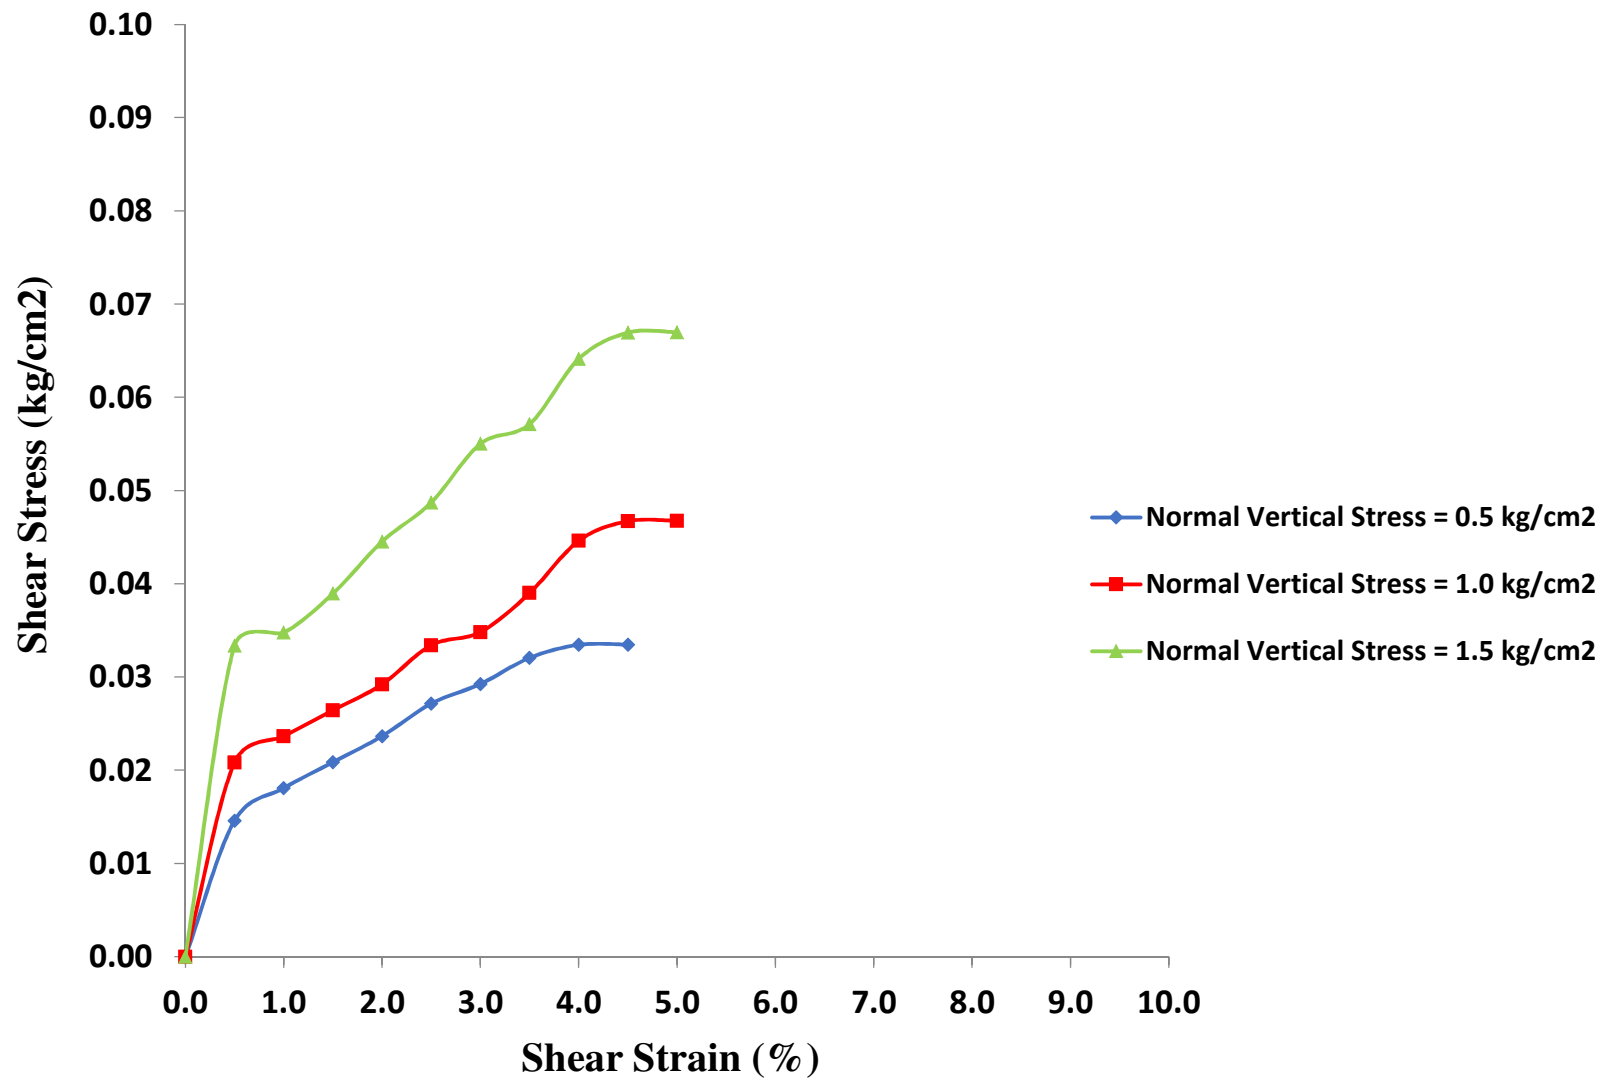




SHEAR STRESS-STRAIN CURVE

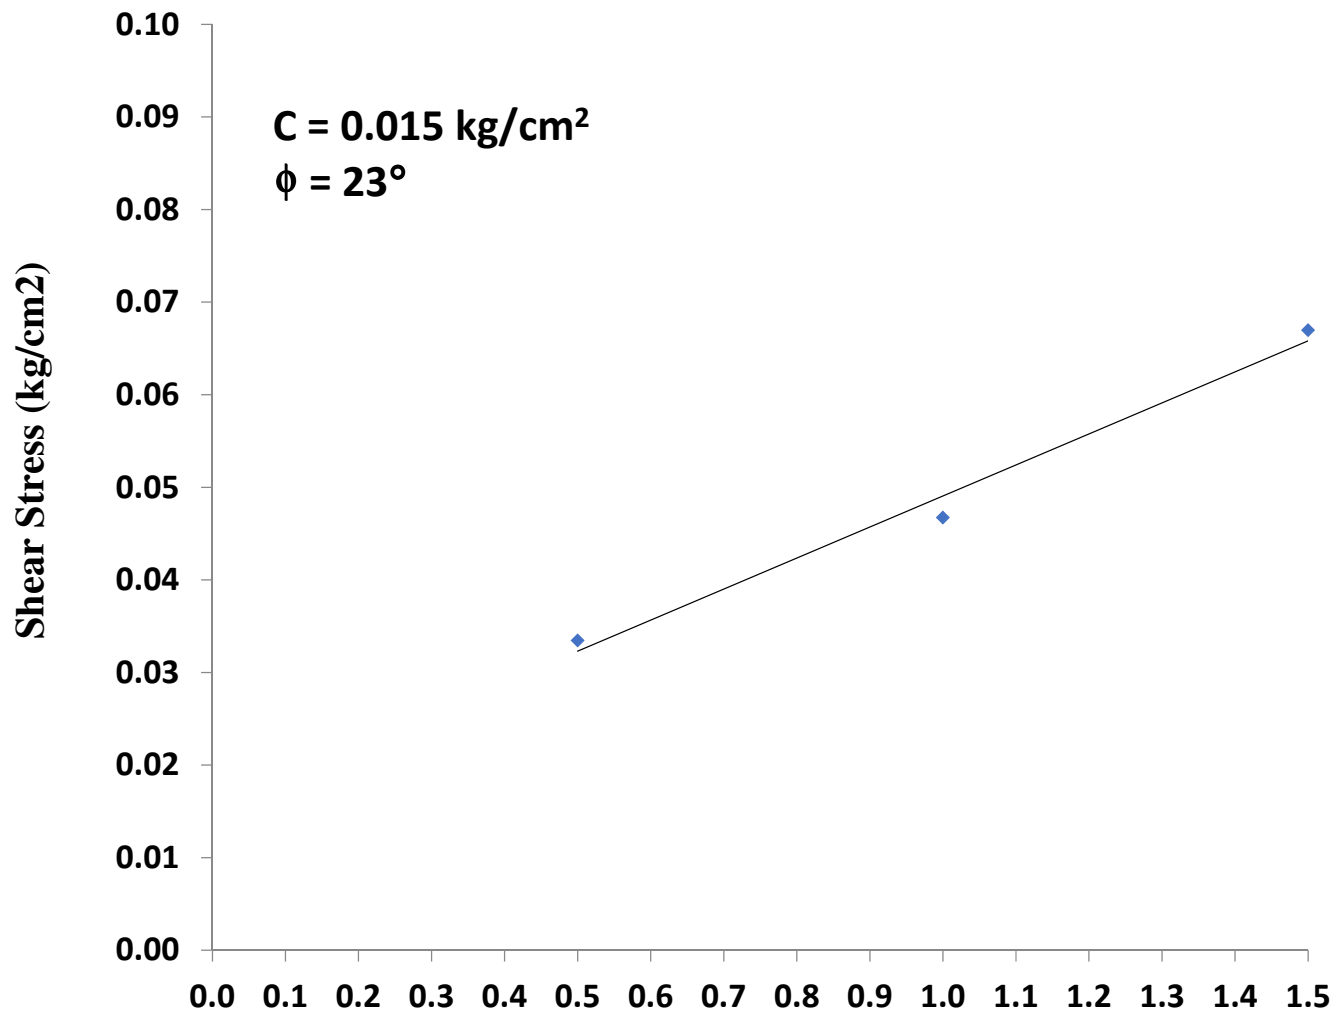





Normal Stress (kg/cm²)
FAILURE ENVELOP

Fig. A

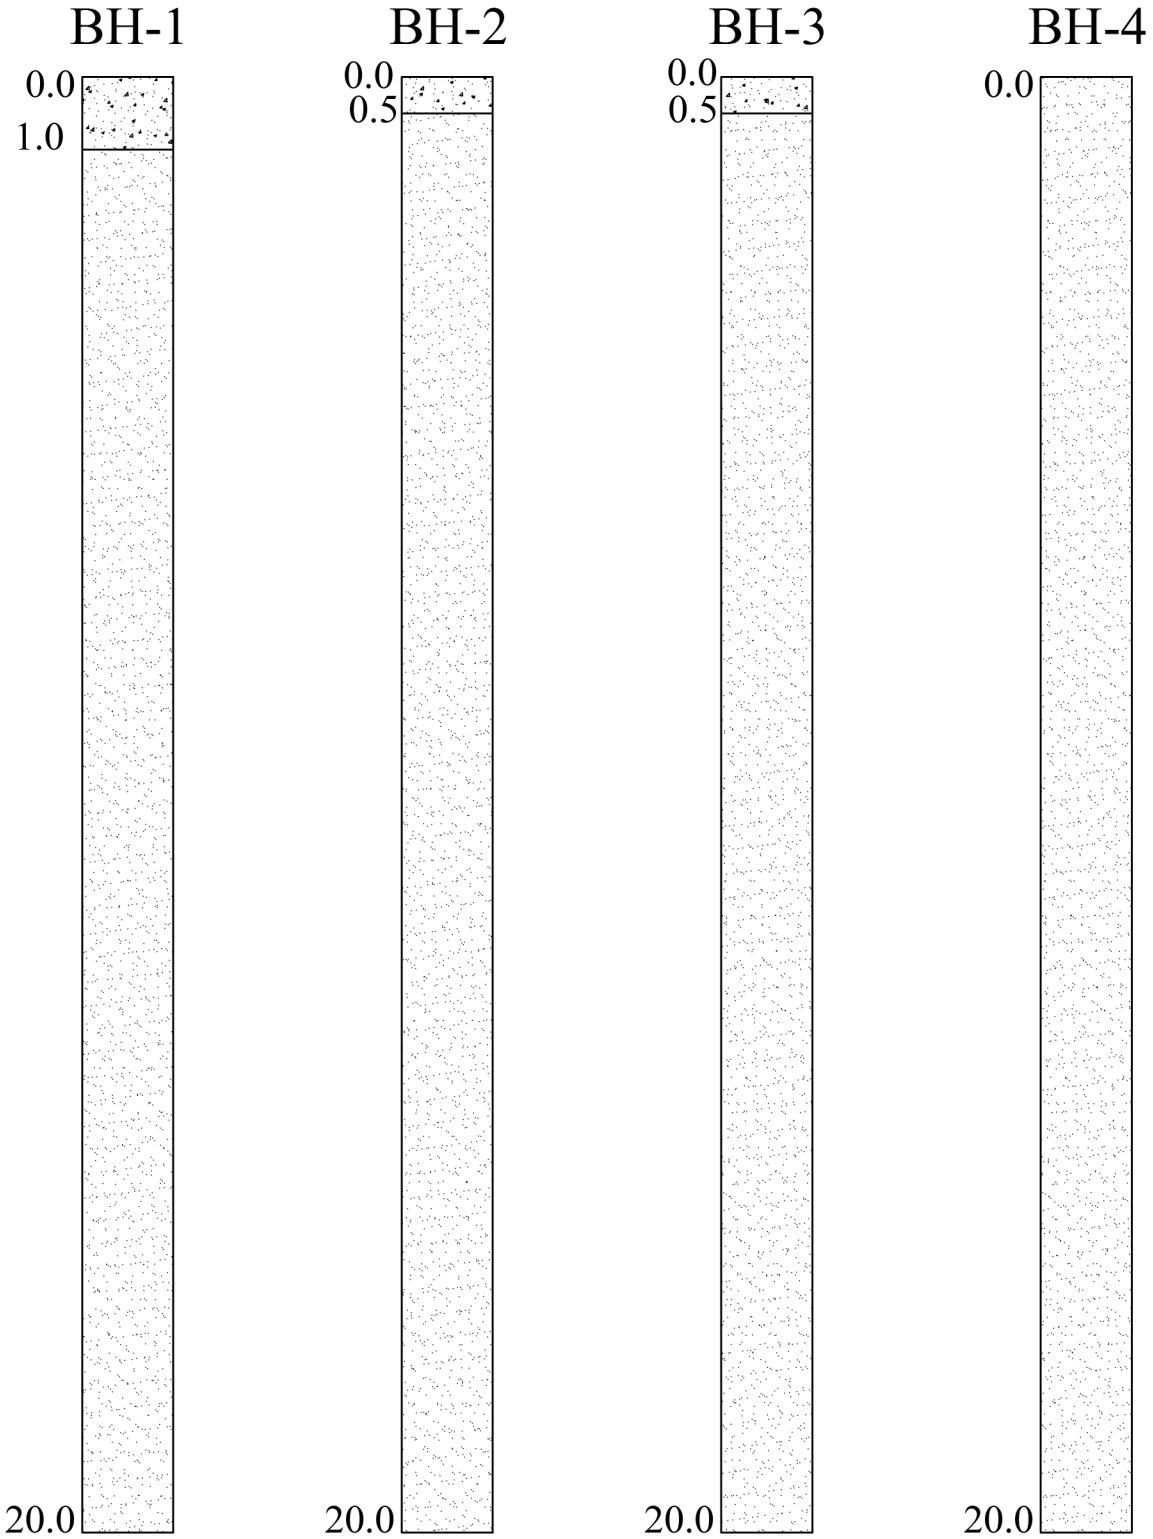

LEGEND	
FILLED UP SOIL	
Silty Sand	



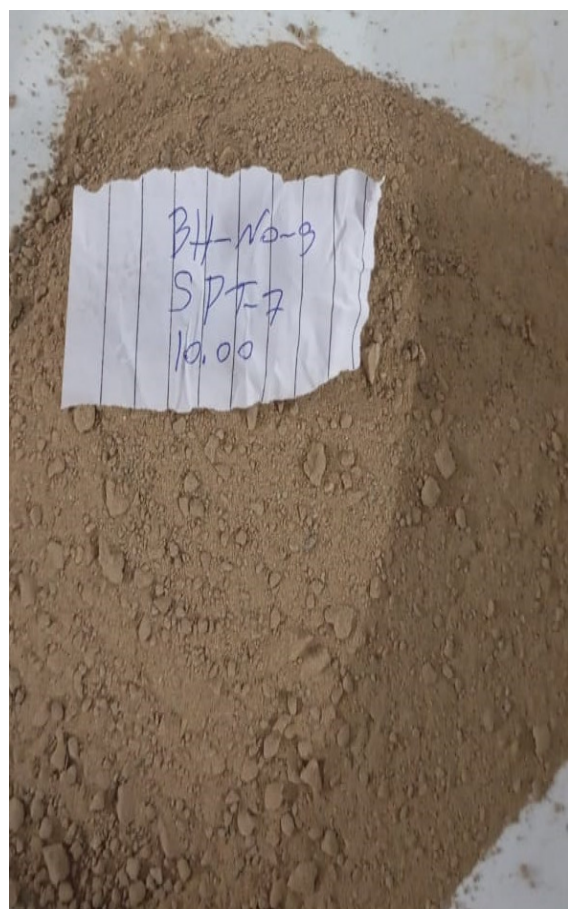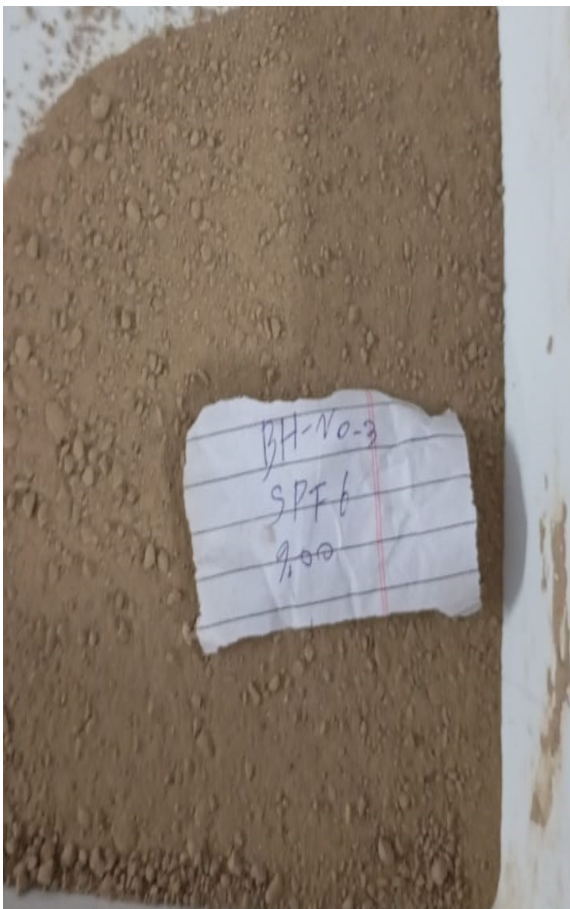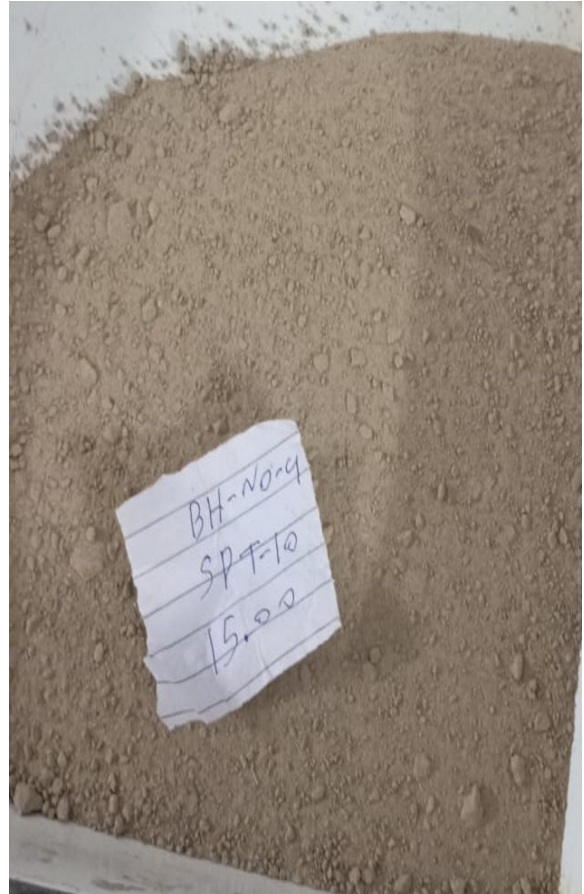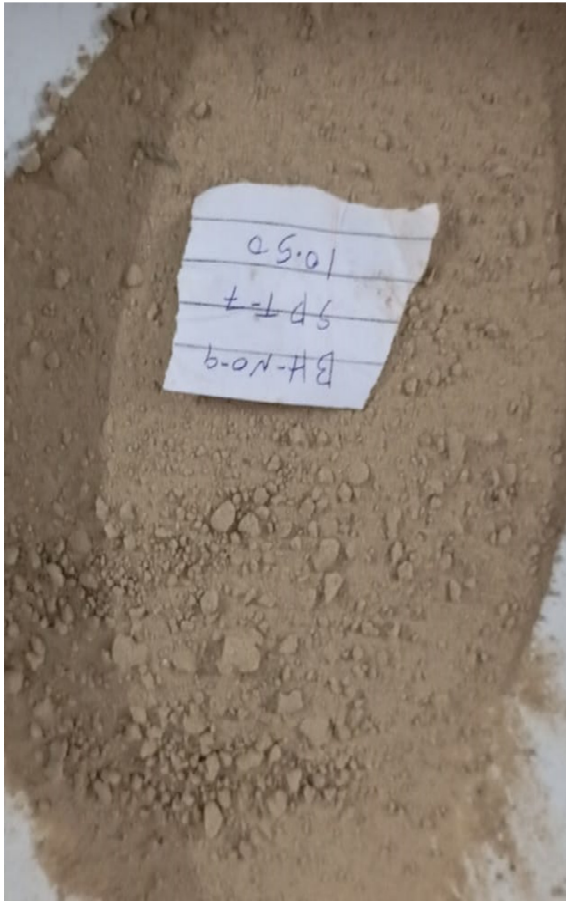



APPENDIX – ‘A’

LIST OF REFERRED IS CODES

Field Investigation

1. IS: 1948-1970 Classification and identification of soils for general engineering purposes (first revision) Amendment 2
2. IS: 1892-1979 Code of practice for sub surface investigations for foundations
3. IS: 2131-1981 Method of standard penetration tests for soils
4. IS: 2132-1986 Code of practice for thin walled tube sampling of soils
5. IS: 6935: 1973 Method for determination of water level
6. IS: 3043-1987 Practice For Earthing

Laboratory tests

1. IS: 2720-1983 (Part 1) Methods of tests for soils: Preparation of dry soil samples for various tests (second revision)
2. IS: 2720-1980 (Part-2) Methods of test for soils: Determination of water content (second revision) Amendment 1
3. IS: 2720-1980 (Part-3/Sec 1) Method of test for soil: Determination of specificgravity: Fine grained soils
4. IS: 2720-1980 (Part-3/Sec 2) Method of test for soil: Determination of specificgravity:Fine, medium & coarse grained soils. (First revision)
5. IS: 2720-1985 (Part-4) Methods of test for soils: Grain size analysis (Second revision)
6. IS: 2720-1985 (Part-5) Methods of test for soils: Determination of liquid and plastic limit (Second revision)
7. IS: 2720 (Part-8) Determination of water content – dry density relation using heavy compaction. (First revision)
8. IS: 2720 (Part-10) Methods of test for soils: Determination of Shear strength Parameter using triaxial apparatus.
9. IS: 1498 - 1970 Classification and identification of soils for general engineering purposes.
10. IS: 3015-1987 Methods of Sampling and Test (Physical and Chemical) For Water and Wastewater

Foundation Construction

1. IS: 1080-1986Code of Practice for design and construction of shallow foundation on soils (other than raft, ring and shall) (Second revision)
2. IS: 1904-1986Code of Practice for design and construction offoundation in soils: First Revision (Amendment 1)
3. IS: 6403-1981 Code of Practice for determination of bearing capacity of shallow foundation: First revision (Amendment 1)
4. IS: 2911 (part-III) Code of Practice for Design and Construction of Pile Foundations.
5. IS: 2720(part 16)-1987 Laboratory Determination of CBR
6. IS: 8009 (part 2)-1980 Settlement for shallow &deep foundations
7. IS: 1893 (Part-1) Criteria for Earthquake Resistant Design of Structures
8. IS: 2950-1 (Part-1) Practice for design and construction of raft foundations, Design